PHILIPPINE BIDDING DOCUMENTS

Procurement of INFRASTRUCTURE PROJECTS

Government of the Republic of the Philippines

PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE ELEMENTARY SCHOOL

Project number: 22-00160

Sixth Edition July 2020

Preface

These Philippine Bidding Documents (PBDs) for the procurement of Infrastructure Projects (hereinafter referred to also as the "Works") through Competitive Bidding have been prepared by the Government of the Philippines for use by all branches, agencies, departments, bureaus, offices, or instrumentalities of the government, including government-owned and/or -controlled corporations, government financial institutions, state universities and colleges, local government units, and autonomous regional government. The procedures and practices presented in this document have been developed through broad experience, and are for mandatory use in projects that are financed in whole or in part by the Government of the Philippines or any foreign government/foreign or international financing institution in accordance with the provisions of the 2016 revised Implementing Rules and Regulations (IRR) of Republic Act (RA) No. 9184.

The PBDs are intended as a model for admeasurements (unit prices or unit rates in a bill of quantities) types of contract, which are the most common in Works contracting.

The Bidding Documents shall clearly and adequately define, among others: (i) the objectives, scope, and expected outputs and/or results of the proposed contract; (ii) the eligibility requirements of Bidders; (iii) the expected contract duration; and (iv)the obligations, duties, and/or functions of the winning Bidder.

Care should be taken to check the relevance of the provisions of the PBDs against the requirements of the specific Works to be procured. If duplication of a subject is inevitable in other sections of the document prepared by the Procuring Entity, care must be exercised to avoid contradictions between clauses dealing with the same matter.

Moreover, each section is prepared with notes intended only as information for the Procuring Entity or the person drafting the Bidding Documents. They shall not be included in the final documents. The following general directions should be observed when using the documents:

- a. All the documents listed in the Table of Contents are normally required for the procurement of Infrastructure Projects. However, they should be adapted as necessary to the circumstances of the particular Project.
- b. Specific details, such as the "name of the Procuring Entity" and "address for bid submission," should be furnished in the Instructions to Bidders, Bid Data Sheet, and Special Conditions of Contract. The final documents should contain neither blank spaces nor options.
- c. This Preface and the footnotes or notes in italics included in the Invitation to Bid, BDS, General Conditions of Contract, Special Conditions of Contract, Specifications, Drawings, and Bill of Quantities are not part of the text of the final document, although they contain instructions that the Procuring Entity should strictly follow.
- d. The cover should be modified as required to identify the Bidding Documents as to the names of the Project, Contract, and Procuring Entity, in addition to date of issue.

- e. Modifications for specific Procurement Project details should be provided in the Special Conditions of Contract as amendments to the Conditions of Contract. For easy completion, whenever reference has to be made to specific clauses in the Bid Data Sheet or Special Conditions of Contract, these terms shall be printed in bold typeface on Sections I (Instructions to Bidders) and III (General Conditions of Contract), respectively.
- f. For guidelines on the use of Bidding Forms and the procurement of Foreign-Assisted Projects, these will be covered by a separate issuance of the Government Procurement Policy Board.

TABLE OF CONTENTS

Glossai	ry of Terms, Abbreviations, and Acronyms	5
Section	I. Invitation to Bid	8
Section	II. Instructions to Bidders	9
1.	Scope of Bid	10
2.	Funding Information	10
3.	Bidding Requirements	10
4.	Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices	10
5.	Eligible Bidders	11
6.	Origin of Associated Goods	11
7.	Subcontracts	11
8.	Pre-Bid Conference	12
9.	Clarification and Amendment of Bidding Documents	12
10.	Documents Comprising the Bid: Eligibility and Technical Components	12
11.	Documents Comprising the Bid: Financial Component	13
12.	Alternative Bids	13
13.	Bid Prices	13
14.	Bid and Payment Currencies	13
15.	Bid Security	14
16.	Sealing and Marking of Bids	14
17.	Deadline for Submission of Bids	14
18.	Opening and Preliminary Examination of Bids	14
19.	Detailed Evaluation and Comparison of Bids	14
20.	Post Qualification	15
21.	Signing of the Contract	15
Section	III. Bid Data Sheet	16
Section	IV. General Conditions of Contract	19
1.	Scope of Contract	20
2.	Sectional Completion of Works	20
3.	Possession of Site	20
4.	The Contractor's Obligations	20
5.	Performance Security	20
6.	Site Investigation Reports	21

Warranty	21
Liability of the Contractor	21
Termination for Other Causes	21
Dayworks	22
Program of Work	22
Instructions, Inspections and Audits	22
Advance Payment	22
Progress Payments	22
Operating and Maintenance Manuals	22
V. Special Conditions of Contract	24
VI. Specifications	26
VII. Drawings	28
_	
IX. Checklist of Technical and Financial Documents	
	Liability of the Contractor

Glossary of Terms, Abbreviations, and Acronyms

ABC – Approved Budget for the Contract.

ARCC – Allowable Range of Contract Cost.

BAC – Bids and Awards Committee.

Bid – A signed offer or proposal to undertake a contract submitted by a bidder in response to and in consonance with the requirements of the bidding documents. Also referred to as *Proposal* and *Tender*. (2016 revised IRR, Section 5[c])

Bidder – Refers to a contractor, manufacturer, supplier, distributor and/or consultant who submits a bid in response to the requirements of the Bidding Documents. (2016 revised IRR, Section 5[d])

Bidding Documents – The documents issued by the Procuring Entity as the bases for bids, furnishing all information necessary for a prospective bidder to prepare a bid for the Goods, Infrastructure Projects, and/or Consulting Services required by the Procuring Entity. (2016 revised IRR, Section 5[e])

BIR – Bureau of Internal Revenue.

BSP – Bangko Sentral ng Pilipinas.

CDA – Cooperative Development Authority.

Consulting Services – Refer to services for Infrastructure Projects and other types of projects or activities of the GOP requiring adequate external technical and professional expertise that are beyond the capability and/or capacity of the GOP to undertake such as, but not limited to: (i) advisory and review services; (ii) pre-investment or feasibility studies; (iii) design; (iv) construction supervision; (v) management and related services; and (vi) other technical services or special studies. (2016 revised IRR, Section 5[i])

Contract – Refers to the agreement entered into between the Procuring Entity and the Supplier or Manufacturer or Distributor or Service Provider for procurement of Goods and Services; Contractor for Procurement of Infrastructure Projects; or Consultant or Consulting Firm for Procurement of Consulting Services; as the case may be, as recorded in the Contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein.

Contractor – is a natural or juridical entity whose proposal was accepted by the Procuring Entity and to whom the Contract to execute the Work was awarded. Contractor as used in these Bidding Documents may likewise refer to a supplier, distributor, manufacturer, or consultant.

CPI – Consumer Price Index.

DOLE – Department of Labor and Employment.

DTI – Department of Trade and Industry.

Foreign-funded Procurement or Foreign-Assisted Project – Refers to procurement whose funding source is from a foreign government, foreign or international financing institution as specified in the Treaty or International or Executive Agreement. (2016 revised IRR, Section 5[b]).

GFI – Government Financial Institution.

GOCC – Government-owned and/or –controlled corporation.

Goods – Refer to all items, supplies, materials and general support services, except Consulting Services and Infrastructure Projects, which may be needed in the transaction of public businesses or in the pursuit of any government undertaking, project or activity, whether in the nature of equipment, furniture, stationery, materials for construction, or personal property of any kind, including non-personal or contractual services such as the repair and maintenance of equipment and furniture, as well as trucking, hauling, janitorial, security, and related or analogous services, as well as procurement of materials and supplies provided by the Procuring Entity for such services. The term "related" or "analogous services" shall include, but is not limited to, lease or purchase of office space, media advertisements, health maintenance services, and other services essential to the operation of the Procuring Entity. (2016 revised IRR, Section 5[r])

GOP – Government of the Philippines.

Infrastructure Projects – Include the construction, improvement, rehabilitation, demolition, repair, restoration or maintenance of roads and bridges, railways, airports, seaports, communication facilities, civil works components of information technology projects, irrigation, flood control and drainage, water supply, sanitation, sewerage and solid waste management systems, shore protection, energy/power and electrification facilities, national buildings, school buildings, hospital buildings, and other related construction projects of the government. Also referred to as *civil works or works*. (2016 revised IRR, Section 5[u])

LGUs – Local Government Units.

NFCC - Net Financial Contracting Capacity.

NGA – National Government Agency.

PCAB – Philippine Contractors Accreditation Board.

PhilGEPS - Philippine Government Electronic Procurement System.

Procurement Project – refers to a specific or identified procurement covering goods, infrastructure project or consulting services. A Procurement Project shall be described, detailed, and scheduled in the Project Procurement Management Plan prepared by the agency which shall be consolidated in the procuring entity's Annual Procurement Plan. (GPPB Circular No. 06-2019 dated 17 July 2019)

PSA – Philippine Statistics Authority.

SEC – Securities and Exchange Commission.

SLCC – Single Largest Completed Contract.

UN – United Nations.

Section I. Invitation to Bid

Notes on the Invitation to Bid

The Invitation to Bid (IB) provides information that enables potential Bidders to decide whether to participate in the procurement at hand. The IB shall be posted in accordance with Section 21.2 of the 2016 revised IRR of RA No. 9184.

Apart from the essential items listed in the Bidding Documents, the IB should also indicate the following:

- a. The date of availability of the Bidding Documents, which shall be from the time the IB is first advertised/posted until the deadline for the submission and receipt of bids;
- b. The place where the Bidding Documents may be acquired or the website where it may be downloaded;
- c. The deadline for the submission and receipt of bids; and
- d. Any important bid evaluation criteria.

The IB should be incorporated into the Bidding Documents. The information contained in the IB must conform to the Bidding Documents and in particular to the relevant information in the Bid Data Sheet.



REPUBLIC OF THE PHILIPPINES QUEZON CITY GOVERNMENT D AWARDS COMMITTEE FOR INFRASTRACTS



BIDS AND AWARDS COMMITTEE FOR INFRASTRACTURE & CONSULTANCY

2nd floor, Finance Building, Procurement Department, Quezon City Hall Complex, Elliptical Road, Quezon City

November 25, 2022

Invitation to Bid

No	Project No.	Project Name	Location	Amount	Durati on Cal. Days	Office	Source Fund
Ви	ildings -	Small B					
1	22- 00160	Proposed Upgrading of Electrical System at Villa Verde Elementary School	Sta. Monica	1,283,171.56	30	Engineering Department	SDO - Loca School Board
2	22- 00161			2,352,427.79	60	Engineering Department	SDO - Loca School Board
3	22- 00162	Proposed Construction of Additional Handwashing Facility and Rehabilitation of Comfort Rooms at Sinagtala Elementary School	San Antonio	2,523,866.59	60	Engineering Department	SDO - Loca School Board
4	22- 00163	Proposed Rehabilitation of Comfort Rooms at Camarilla Elementary School	San Roque	3,030,957.00	90	Engineering Department	SDO - Loca School Board
5	22- 00164	Proposed Rehabilitation of Comfort rooms at Balumbato Elementary School	Balumbat o	4,272,283.81	90	Engineering Department	SDO - Loca School Board
Б	22- 00165	Proposed Rehabilitation of Covered Court at Hobart Village HOA, Inc.	Kaligayah an	6,124,499.75	120	Engineering Department	OCM - 20% CDF
7	22- 00166	Proposed Rehabilitation of Electrical System at Bagbag Elementary School	Bagbag	7,032,679.79	120	Engineering Department	SDO - Loca School Board
8	22- 00167	Proposed Rehabilitation of Barangay Health Center and Vargas Multi-Purpose Hall	San Agustin	7,817,907.96	90	Engineering Department	OCM - 20% CDF
9	22- 00168	Proposed Rehabilitation of HB Building at San Diego Elementary School	Batasan Hills	20,251,081.84	180	Engineering Department	SDO - Loca School Board
10	22- 00169	Proposed Rehabilitation of Bautista Building, Drainage System and Construction of Comfort Room at North Fairview High School	North Fairview	20,847,208.56	180	Engineering Department	SDO - Loca School Board

17 18	22- 00174 22- 00175	Proposed Rehabilitation of Drainage System at Ismael Mathay Senior High School Proposed Construction of Drainage System at	Sanganda an Pasong Putik	1,455,721.93 7,926,563.46	90	Engineering Department Engineering Department	SDO - Local School Board SDO - Local School Board
	Total State of Comment of the	Drainage System at Ismael Mathay Senior High		1,455,721.93	90	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	DESTRUCTION OF THE PARTY
	ads – Sr	nall B					
16	22- 00173	Proposed Rehabilitation of San Bartolome High School	San Bartolome	50,033,897,53	180	Engineering Department	SDO - Loca School Board
15	22- 00172	Proposed Rehabilitation of Mathay and Quezon Building of Novaliches High School	San Agustin	44,286,369.31	180	Engineering Department	SDO - Loca School Board
Ru	ildinas -	- Medium A					
14	22- 00102B	Proposed Rehabilitation of Fire Station	Project 6	1,963,027.52	60	Engineering Department	Engineering Department
13	22- 00099B	Proposed Construction of Handwashing Facility and Rehabilitation of Comfort Room at Manuel Roxas Senior High School	Paligsaha n	1,703,245.31	60	Engineering Department	Special Education Fund
12	22- 00171	Proposed Construction of Electrical Room and Upgrading of Electrical System at Don Alejandro Roces Sr. Science Technology High School	Obrero	24,253,074.13	180	Engineering Department	SDO - Loca School Board
11	22- 00170	Proposed Construction of Perimeter Fence and Upgrading of Electrical System at San Bartolome Elementary School	San Bartolome	21,320,673.64	180	Engineering Department	SDO - Loca School Board

The QUEZON CITY LOCAL GOVERNMENT, through funding source of various years intends to apply the sum stated above being the Approved Budget for the Contract (ABC) to payments under the contract for the above stated Projects. Bids received in excess of the ABC shall be automatically rejected at bid opening.

- The QUEZON CITY LOCAL GOVERNMENT now invites bids for the above Procurement Project. Completion of the Works is required as stated above. Bidders should have completed a contract similar to the Project. The description of an eligible bidder is contained in the Bidding Documents, particularly, in Section II (Instructions to Bidders).
- Bidding will be conducted through open competitive bidding procedures using nondiscretionary "pass/fail" criterion as specified in the 2016 revised Implementing Rules and Regulations (IRR) of Republic Act (RA) No. 9184.
- Interested bidders may obtain further information from QUEZON CITY LOCAL GOVERNMENT – BAC Secretariat and inspect the Bidding Documents at the address given below weekdays from 8:00 am. – 5:00 p.m.
- 5. A complete set of Bidding Documents may be acquired by interested bidders on 28 November 2022 (Monday) from given address and website/s below and upon payment of a non-refundable fee for the Bidding Documents, pursuant to the latest Guidelines issued by the GPPB. The Procuring Entity shall allow the bidder to present its proof of payment for the fees presented in person.

STANDARD RATES:

Approved Budget for the Contract	Maximum Cost of Bidding Documents (in Philippine Peso)
More than 1 Million up to 5 Million	5,000.00
More than 5 Million up to 10 Million	10,000.00
More than 10 Million up to 50 Million	25,000.00
More than 50 Million up to 500 Million	50,000.00
More than 500 Million	75,000.00

The following are the requirements for purchase of Bidding Documents;

- PhilGEPS Registration Certificate (Platinum 3 Pages)
- Document Request List (DRL)
- 3. Authorization to purchase bidding documents
 - 3.1 Secretary's Certificate (for corporation)
 - 3.2 Special Power of Attorney (for sole proprietorship)
- 4. Notarized Joint Venture Agreement (if applicable)
- 5. Letter of Intent

It must be duly received by the BAC Secretariat at 2nd Floor, Procurement Department, Finance Building, Quezon City Hall Compound.

6. The QC-BAC-INFRASTRUCTURE & CONSULTANCY will hold a Pre-Bid Conference¹ on December 6, 2022 at 9:00 AM at 2nd Floor, Procurement Department-Bidding Room, Finance Building, Quezon City Hall Compound or we encourage the prospective bidders to join through our Virtual Conference (ZOOM APP) which shall be open to prospective bidders.

Virtual Conference (ZOOM APP)

Meeting ID: 854 9489 0133

Password: 273320

 Bids must be duly received by the BAC Secretariat through manual submission at the office address as indicated below, on or before December 19, 2022 – 9:00 AM. Late bids shall not be accepted.

May be deleted in case the ABC is less than One Million Pesos (PhP1,000,000) where the Procuring Entity may not hold a pre-bid conference.

- All bids must be accompanied by a bid security in any of the acceptable forms and in the amount stated in ITB Clause 16.
- Bid opening shall be on December 19, 2022 10:00 AM at 2nd Floor, Procurement Department-Bidding Room, Finance Building, Quezon City Hall Compound and/or via Zoom. Bids will be opened in the presence of the bidders' representatives who choose to attend the activity.

Virtual Conference (ZOOM APP)

Meeting ID: 810 3646 5257

Password: 201522

- 10. The Quezon City Local Government reserves the right to reject any and all bids, declare a failure of bidding, or not award the contract at any time prior to contract award in accordance with Sections 35.6 and 41 of the 2016 revised Implementing Rules and Regulations (IRR) of RA No. 9184, without thereby incurring any liability to the affected bidder or bidders.
- 11. For further information, please refer to:

ATTY, DOMINIC B. GARCIA

OIC, Procurement Department 2nd Floor, Procurement Department, Finance Building, Quezon City Hall Compound Elliptical Road, Barangay Central Diliman, Quezon City. Tel. No. (02)8988-4242 loc. 8506/8710 Email Add: bacinfra.procurement@quezoncity.gov.ph

Website: www.quezoncity.gov.ph

12. You may visit the following websites:

For downloading of Bidding Documents: https://quezoncity.gov.ph/public-notices/procurement/

By:

ATTY. MARK DALE DIAMOND P. PERRAL Chairman, BAC-Infra and Consultancy

Section II. Instructions to Bidders

Notes on the Instructions to Bidders

This Section on the Instruction to Bidders (ITB) provides the information necessary for bidders to prepare responsive bids, in accordance with the requirements of the Procuring Entity. It also provides information on bid submission, eligibility check, opening and evaluation of bids, post-qualification, and on the award of contract.

1. Scope of Bid

The Procuring Entity, Quezon City Government invites Bids for the PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE ELEMENTARY SCHOOL, with Project Identification Number 22-00160.

[Note: The Project Identification Number is assigned by the Procuring Entity based on its own coding scheme and is not the same as the PhilGEPS reference number, which is generated after the posting of the bid opportunity on the PhilGEPS website.]

The Procurement Project (referred to herein as "Project") is for the construction of Works, as described in Section VI (Specifications).

2. Funding Information

- 2.1. The GOP through the source of funding as indicated below for 2022 in the amount of One Million Two Hundred Eighty-Three Thousand One Hundred Seventy-One Pesos and 56/100 Ctvs. (P 1,283,171.56).
- 2.2. The source of funding is:
 - a. LGUs, the Annual or Supplemental Budget, as approved by the Sanggunian.

3. Bidding Requirements

The Bidding for the Project shall be governed by all the provisions of RA No. 9184 and its 2016 revised IRR, including its Generic Procurement Manual and associated policies, rules and regulations as the primary source thereof, while the herein clauses shall serve as the secondary source thereof.

Any amendments made to the IRR and other GPPB issuances shall be applicable only to the ongoing posting, advertisement, or invitation to bid by the BAC through the issuance of a supplemental or bid bulletin.

The Bidder, by the act of submitting its Bid, shall be deemed to have inspected the site, determined the general characteristics of the contracted Works and the conditions for this Project, such as the location and the nature of the work; (b) climatic conditions; (c) transportation facilities; (c) nature and condition of the terrain, geological conditions at the site communication facilities, requirements, location and availability of construction aggregates and other materials, labor, water, electric power and access roads; and (d) other factors that may affect the cost, duration and execution or implementation of the contract, project, or work and examine all instructions, forms, terms, and project requirements in the Bidding Documents.

4. Corrupt, Fraudulent, Collusive, Coercive, and Obstructive Practices

The Procuring Entity, as well as the Bidders and Contractors, shall observe the highest standard of ethics during the procurement and execution of the contract. They or through an agent shall not engage in corrupt, fraudulent, collusive, coercive, and obstructive practices defined under Annex "I" of the 2016 revised IRR of RA No. 9184 or other integrity violations in competing for the Project.

5. Eligible Bidders

- 5.1. Only Bids of Bidders found to be legally, technically, and financially capable will be evaluated.
- 5.2. The Bidder must have an experience of having completed a Single Largest Completed Contract (SLCC) that is similar to this Project, equivalent to at least fifty percent (50%) of the ABC adjusted, if necessary, by the Bidder to current prices using the PSA's CPI, except under conditions provided for in Section 23.4.2.4 of the 2016 revised IRR of RA No. 9184.

A contract is considered to be "similar" to the contract to be bid if it has the major categories of work stated in the **BDS**.

- 5.3. For Foreign-funded Procurement, the Procuring Entity and the foreign government/foreign or international financing institution may agree on another track record requirement, as specified in the Bidding Document prepared for this purpose.
- 5.4. The Bidders shall comply with the eligibility criteria under Section 23.4.2 of the 2016 IRR of RA No. 9184.

6. Origin of Associated Goods

There is no restriction on the origin of Goods other than those prohibited by a decision of the UN Security Council taken under Chapter VII of the Charter of the UN.

7. Subcontracts

7.1. The Bidder may subcontract portions of the Project to the extent allowed by the Procuring Entity as stated herein, but in no case more than fifty percent (50%) of the Project.

The Procuring Entity has prescribed that:

a. Subcontracting is not allowed.

- 7.1. [If Procuring Entity has determined that subcontracting is allowed during the bidding, state:] The Bidder must submit together with its Bid the documentary requirements of the subcontractor(s) complying with the eligibility criterial stated in **ITB** Clause 5 in accordance with Section 23.4 of the 2016 revised IRR of RA No. 9184 pursuant to Section 23.1 thereof.
- 7.2. [If subcontracting is allowed during the contract implementation stage, state:] The Supplier may identify its subcontractor during the contract implementation stage. Subcontractors identified during the bidding may be changed during the implementation of this Contract. Subcontractors must submit the documentary

requirements under Section 23.1 of the 2016 revised IRR of RA No. 9184 and comply with the eligibility criteria specified in **ITB** Clause 5 to the implementing or end-user unit.

7.3. Subcontracting of any portion of the Project does not relieve the Contractor of any liability or obligation under the Contract. The Supplier will be responsible for the acts, defaults, and negligence of any subcontractor, its agents, servants, or workmen as fully as if these were the Contractor's own acts, defaults, or negligence, or those of its agents, servants, or workmen.

8. Pre-Bid Conference

The Procuring Entity will hold a pre-bid conference for this Project on the specified date and time and either at its physical address on **December 6, 2022, 9:00 A.M. at 2nd Floor, Procurement Department-Bidding Room, Finance Building, Quezon City Hall Compound** and/or we encourage the prospective bidders to join through our **Virtual Conference (ZOOM APP) Meeting ID: 854 9489 0133 Password: 273320**

9. Clarification and Amendment of Bidding Documents

Prospective bidders may request for clarification on and/or interpretation of any part of the Bidding Documents. Such requests must be in writing and received by the Procuring Entity, either at its given address or through electronic mail indicated in the **IB**, at least ten (10) calendar days before the deadline set for the submission and receipt of Bids.

10. Documents Comprising the Bid: Eligibility and Technical Components

- 10.1. The first envelope shall contain the eligibility and technical documents of the Bid as specified in **Section IX. Checklist of Technical and Financial Documents**.
- 10.2. If the eligibility requirements or statements, the bids, and all other documents for submission to the BAC are in foreign language other than English, it must be accompanied by a translation in English, which shall be authenticated by the appropriate Philippine foreign service establishment, post, or the equivalent office having jurisdiction over the foreign bidder's affairs in the Philippines. For Contracting Parties to the Apostille Convention, only the translated documents shall be authenticated through an apostille pursuant to GPPB Resolution No. 13-2019 dated 23 May 2019. The English translation shall govern, for purposes of interpretation of the bid.
- 10.3. A valid PCAB License is required, and in case of joint ventures, a valid special PCAB License, and registration for the type and cost of the contract for this Project. Any additional type of Contractor license or permit shall be indicated in the **BDS**.
- 10.4. A List of Contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen) assigned to the contract to be bid, with their

- complete qualification and experience data shall be provided. These key personnel must meet the required minimum years of experience set in the **BDS**.
- 10.5. A List of Contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership, certification of availability of equipment from the equipment lessor/vendor for the duration of the project, as the case may be, must meet the minimum requirements for the contract set in the **BDS**.

11. Documents Comprising the Bid: Financial Component

- 11.1. The second bid envelope shall contain the financial documents for the Bid as specified in **Section IX. Checklist of Technical and Financial Documents**.
- 11.2. Any bid exceeding the ABC indicated in paragraph 1 of the **IB** shall not be accepted.
- 11.3. For Foreign-funded procurement, a ceiling may be applied to bid prices provided the conditions are met under Section 31.2 of the 2016 revised IRR of RA No. 9184.

12. Alternative Bids

Bidders shall submit offers that comply with the requirements of the Bidding Documents, including the basic technical design as indicated in the drawings and specifications. Unless there is a value engineering clause in the **BDS**, alternative Bids shall not be accepted.

13. Bid Prices

All bid prices for the given scope of work in the Project as awarded shall be considered as fixed prices, and therefore not subject to price escalation during contract implementation, except under extraordinary circumstances as determined by the NEDA and approved by the GPPB pursuant to the revised Guidelines for Contract Price Escalation guidelines.

14. Bid and Payment Currencies

- 14.1. Bid prices may be quoted in the local currency or tradeable currency accepted by the BSP at the discretion of the Bidder. However, for purposes of bid evaluation, Bids denominated in foreign currencies shall be converted to Philippine currency based on the exchange rate as published in the BSP reference rate bulletin on the day of the bid opening.
- 14.2. Payment of the contract price shall be made in:
 - a. Philippine Pesos.

15. Bid Security

- 15.1. The Bidder shall submit a Bid Securing Declaration or any form of Bid Security in the amount indicated in the **BDS**, which shall be not less than the percentage of the ABC in accordance with the schedule in the **BDS**.
- 15.2. The Bid and bid security in no case shall exceed One Hundred Twenty (120) calendar days from the date of opening of bids, unless duly extended by the bidder upon the request of the Head of the Procuring Entity (HoPE) of the Quezon City Local Government. Any bid not accompanied by an acceptable bid security shall be rejected by the Procuring Entity as non-responsive.

16. Sealing and Marking of Bids

Each Bidder shall submit one copy of the first and second components of its Bid.

The Procuring Entity may request additional hard copies and/or electronic copies of the Bid. However, failure of the Bidders to comply with the said request shall not be a ground for disqualification.

If the Procuring Entity allows the submission of bids through online submission to the given website or any other electronic means, the Bidder shall submit an electronic copy of its Bid, which must be digitally signed. An electronic copy that cannot be opened or is corrupted shall be considered non-responsive and, thus, automatically disqualified.

17. Deadline for Submission of Bids

The Bidders shall submit on the specified date and time and either at its physical address or through online submission as indicated in paragraph 5 of the IB.

18. Opening and Preliminary Examination of Bids

18.1. The BAC shall open the Bids in public at the time, on the date, and at the place specified in paragraph 9 of the **IB**. The Bidders' representatives who are present shall sign a register evidencing their attendance. In case videoconferencing, webcasting or other similar technologies will be used, attendance of participants shall likewise be recorded by the BAC Secretariat.

In case the Bids cannot be opened as scheduled due to justifiable reasons, the rescheduling requirements under Section 29 of the 2016 revised IRR of RA No. 9184 shall prevail.

18.2. The preliminary examination of Bids shall be governed by Section 30 of the 2016 revised IRR of RA No. 9184.

19. Detailed Evaluation and Comparison of Bids

19.1. The Procuring Entity's BAC shall immediately conduct a detailed evaluation of all Bids rated "passed" using non-discretionary pass/fail criteria. The BAC

shall consider the conditions in the evaluation of Bids under Section 32.2 of 2016 revised IRR of RA No. 9184.

- 19.2. If the Project allows partial bids, all Bids and combinations of Bids as indicated in the **BDS** shall be received by the same deadline and opened and evaluated simultaneously so as to determine the Bid or combination of Bids offering the lowest calculated cost to the Procuring Entity. Bid Security as required by **ITB** Clause 15 shall be submitted for each contract (lot) separately.
- 19.3. In all cases, the NFCC computation pursuant to Section 23.4.2.6 of the 2016 revised IRR of RA No. 9184 must be sufficient for the total of the ABCs for all the lots participated in by the prospective Bidder.

20. Post Qualification

Within a non-extendible period of five (5) calendar days from receipt by the Bidder of the notice from the BAC that it submitted the Lowest Calculated Bid, the Bidder shall submit its latest income and business tax returns filed and paid through the BIR Electronic Filing and Payment System (eFPS), and other appropriate licenses and permits required by law and stated in the **BDS**.

21. Signing of the Contract

The documents required in Section 37.2 of the 2016 revised IRR of RA No. 9184 shall form part of the Contract. Additional Contract documents are indicated in the **BDS**.

Section III. Bid Data Sheet

Notes on the Bid Data Sheet (BDS)

The Bid Data Sheet (BDS) consists of provisions that supplement, amend, or specify in detail, information, or requirements included in the ITB found in Section II, which are specific to each procurement.

This Section is intended to assist the Procuring Entity in providing the specific information in relation to corresponding clauses in the ITB and has to be prepared for each specific procurement.

The Procuring Entity should specify in the BDS information and requirements specific to the circumstances of the Procuring Entity, the processing of the procurement, and the bid evaluation criteria that will apply to the Bids. In preparing the BDS, the following aspects should be checked:

- a. Information that specifies and complements provisions of the ITB must be incorporated.
- b. Amendments and/or supplements, if any, to provisions of the ITB as necessitated by the circumstances of the specific procurement, must also be incorporated.

Bid Data Sheet

ITB Clause					
5.2	For this purpose, similar contracts shall refer to contracts which have the same major categories of work.				
7.1	Subcontracting is not allowed.				
10.3	No additional contractor license or permit is required In addition, eligible bidders shall qualify or comply with the following:				
	1. Bidders with valid Philippine Contractors Accreditation Board (PCAB)				
	Type Building - Small B				
10.4	The minimum work experience following:	requirements fo	r key personnel are the		
	Qnty. Key Personnel Gen	eral Experience	Relevant Experience		
	1 Project-in-Charge (Project Engineer)	3 years	3 years		
	1 General Foreman	3 years	3 years		
	Trade Engineer/Leadman for civil works	3 years	3 years		
	Trade Engineer/Leadman for electrical works	3 years	3 years		
	1 Safety Officer	3 years	3 years		
	In addition, the bidder must execute an affidavit of undertaking du notarized stating that the foregoing personnel shall perform work exclusive for the project until its completion. Please see attached bid forms.				
10.5	The minimum major equipment requirements are the following:				
	Equipment	Capacity	Number of Units		
	Dump Truck Jackhammer		1 1		
	In addition, the bidder must e notarized stating that the foregoi the project until its completion. P	ng equipment sho	all be used exclusively for		
12	[Insert Value Engineering clause	if allowed.]			

15.1	The bid security shall be in the form of a Bid Securing Declaration with project number, or any of the following forms and amounts:			
	number, or any of the following forms and amounts.			
	a) The amount of not less than Php 25,663.43 or equivalent to two percent			
	(2%) of ABC if bid security is in cash, cashier's/manager's check, bank draft/guarantee or irrevocable letter of credit; or			
	b) The amount of not less than Php 64,158.58 or equivalent to five percent (5%) of ABC if bid security is in Surety Bond.			
10.2				
19.2	Partial bid is not allowed. The infrastructure project is packaged in a single lot			
	and the lot shall not be divided into sub-lots for the purpose of bidding,			
	evaluation, and contract award.			
20	No additional requirement.			
21	Additional Contract Documents relevant to the Project as required:			
	1. Construction Schedule and S-curve,			
	2. Manpower Schedule,			
	3. Construction Methods,			
	4. Equipment Utilization Schedule,			
	5. PERT/CPM or other acceptable tools of project scheduling, shall be			
	included in the submission of Technical Proposal.			
L	•			

Section IV. General Conditions of Contract

Notes on the General Conditions of Contract

The General Conditions of Contract (GCC) in this Section, read in conjunction with the Special Conditions of Contract in Section V and other documents listed therein, should be a complete document expressing all the rights and obligations of the parties.

Matters governing performance of the Contractor, payments under the contract, or matters affecting the risks, rights, and obligations of the parties under the contract are included in the GCC and Special Conditions of Contract.

Any complementary information, which may be needed, shall be introduced only through the Special Conditions of Contract.

1. Scope of Contract

This Contract shall include all such items, although not specifically mentioned, that can be reasonably inferred as being required for its completion as if such items were expressly mentioned herein. All the provisions of RA No. 9184 and its 2016 revised IRR, including the Generic Procurement Manual, and associated issuances, constitute the primary source for the terms and conditions of the Contract, and thus, applicable in contract implementation. Herein clauses shall serve as the secondary source for the terms and conditions of the Contract.

This is without prejudice to Sections 74.1 and 74.2 of the 2016 revised IRR of RA No. 9184 allowing the GPPB to amend the IRR, which shall be applied to all procurement activities, the advertisement, posting, or invitation of which were issued after the effectivity of the said amendment.

2. Sectional Completion of Works

If sectional completion is specified in the **Special Conditions of Contract** (SCC), references in the Conditions of Contract to the Works, the Completion Date, and the Intended Completion Date shall apply to any Section of the Works (other than references to the Completion Date and Intended Completion Date for the whole of the Works).

3. Possession of Site

- 3.1 The Procuring Entity shall give possession of all or parts of the Site to the Contractor based on the schedule of delivery indicated in the SCC, which corresponds to the execution of the Works. If the Contractor suffers delay or incurs cost from failure on the part of the Procuring Entity to give possession in accordance with the terms of this clause, the Procuring Entity's Representative shall give the Contractor a Contract Time Extension and certify such sum as fair to cover the cost incurred, which sum shall be paid by Procuring Entity.
 - 3.2 If possession of a portion is not given by the above date, the Procuring Entity will be deemed to have delayed the start of the relevant activities. The resulting adjustments in contract time to address such delay may be addressed through contract extension provided under Annex "E" of the 2016 revised IRR of RA No. 9184.

4. The Contractor's Obligations

The Contractor shall employ the key personnel named in the Schedule of Key Personnel indicating their designation, in accordance with **ITB** Clause 10.3 and specified in the **BDS**, to carry out the supervision of the Works.

The Procuring Entity will approve any proposed replacement of key personnel only if their relevant qualifications and abilities are equal to or better than those of the personnel listed in the Schedule.

5. Performance Security

- 5.1. Within ten (10) calendar days from receipt of the Notice of Award from the Procuring Entity but in no case later than the signing of the contract by both parties, the successful Bidder shall furnish the performance security in any of the forms prescribed in Section 39 of the 2016 revised IRR.
- 5.2. The Contractor, by entering into the Contract with the Procuring Entity, acknowledges the right of the Procuring Entity to institute action pursuant to RA No. 3688 against any subcontractor be they an individual, firm, partnership, corporation, or association supplying the Contractor with labor, materials and/or equipment for the performance of this Contract.

6. Site Investigation Reports

The Contractor, in preparing the Bid, shall rely on any Site Investigation Reports referred to in the SCC supplemented by any information obtained by the Contractor.

7. Warranty

- 7.1. In case the Contractor fails to undertake the repair works under Section 62.2.2 of the 2016 revised IRR, the Procuring Entity shall forfeit its performance security, subject its property(ies) to attachment or garnishment proceedings, and perpetually disqualify it from participating in any public bidding. All payables of the GOP in his favor shall be offset to recover the costs.
- 7.2. The warranty against Structural Defects/Failures, except that occasioned-on force majeure, shall cover the period from the date of issuance of the Certificate of Final Acceptance by the Procuring Entity. Specific duration of the warranty is found in the **SCC**.

8. Liability of the Contractor

Subject to additional provisions, if any, set forth in the SCC, the Contractor's liability under this Contract shall be as provided by the laws of the Republic of the Philippines.

If the Contractor is a joint venture, all partners to the joint venture shall be jointly and severally liable to the Procuring Entity.

9. Termination for Other Causes

Contract termination shall be initiated in case it is determined *prima facie* by the Procuring Entity that the Contractor has engaged, before, or during the implementation of the contract, in unlawful deeds and behaviors relative to contract acquisition and implementation, such as, but not limited to corrupt, fraudulent, collusive, coercive, and obstructive practices as stated in **ITB** Clause 4.

10. Dayworks

Subject to the guidelines on Variation Order in Annex "E" of the 2016 revised IRR of RA No. 9184, and if applicable as indicated in the SCC, the Dayworks rates in the Contractor's Bid shall be used for small additional amounts of work only when the Procuring Entity's Representative has given written instructions in advance for additional work to be paid for in that way.

11. Program of Work

- 11.1. The Contractor shall submit to the Procuring Entity's Representative for approval the said Program of Work showing the general methods, arrangements, order, and timing for all the activities in the Works. The submissions of the Program of Work are indicated in the **SCC**.
- 11.2. The Contractor shall submit to the Procuring Entity's Representative for approval an updated Program of Work at intervals no longer than the period stated in the SCC. If the Contractor does not submit an updated Program of Work within this period, the Procuring Entity's Representative may withhold the amount stated in the SCC from the next payment certificate and continue to withhold this amount until the next payment after the date on which the overdue Program of Work has been submitted.

12. Instructions, Inspections and Audits

The Contractor shall permit the GOP or the Procuring Entity to inspect the Contractor's accounts and records relating to the performance of the Contractor and to have them audited by auditors of the GOP or the Procuring Entity, as may be required.

13. Advance Payment

The Procuring Entity shall, upon a written request of the Contractor which shall be submitted as a Contract document, make an advance payment to the Contractor in an amount not exceeding fifteen percent (15%) of the total contract price, to be made in lump sum, or at the most two installments according to a schedule specified in the **SCC**, subject to the requirements in Annex "E" of the 2016 revised IRR of RA No. 9184.

14. Progress Payments

The Contractor may submit a request for payment for Work accomplished. Such requests for payment shall be verified and certified by the Procuring Entity's Representative/Project Engineer. Except as otherwise stipulated in the SCC, materials and equipment delivered on the site but not completely put in place shall not be included for payment.

15. Operating and Maintenance Manuals

15.1. If required, the Contractor will provide "as built" Drawings and/or operating and maintenance manuals as specified in the **SCC**.

15.2. If the Contractor does not provide the Drawings and/or manuals by the dates stated above, or they do not receive the Procuring Entity's Representative's approval, the Procuring Entity's Representative may withhold the amount stated in the **SCC** from payments due to the Contractor.

Section V. Special Conditions of Contract

Notes on the Special Conditions of Contract

Similar to the BDS, the clauses in this Section are intended to assist the Procuring Entity in providing contract-specific information in relation to corresponding clauses in the GCC found in Section IV.

The Special Conditions of Contract (SCC) complement the GCC, specifying contractual requirements linked to the special circumstances of the Procuring Entity, the Procuring Entity's country, the sector, and the Works procured. In preparing this Section, the following aspects should be checked:

- a. Information that complements provisions of the GCC must be incorporated.
- b. Amendments and/or supplements to provisions of the GCC as necessitated by the circumstances of the specific purchase, must also be incorporated.

However, no special condition which defeats or negates the general intent and purpose of the provisions of the GCC should be incorporated herein.

Special Conditions of Contract

GCC Clause	
2	Completion of work shall be within 30 calendar days.
4.1	The Procuring Entity shall give possession of all parts of the Site to the
	Contractor upon receipt of the Notice to Proceed.
6	The site investigation reports are: [list here the required site investigation reports.]
7.2	[Select one, delete the other.]
	[In case of permanent structures, such as buildings of types 4 and 5 as classified under the National Building Code of the Philippines and other structures made of steel, iron, or concrete which comply with relevant structural codes (e.g., DPWH Standard Specifications), such as, but not limited to, steel/concrete bridges, flyovers, aircraft movement areas, ports, dams, tunnels, filtration and treatment plants, sewerage systems, power plants, transmission and communication towers, railway system, and other similar permanent structures:] Fifteen (15) years.
	[In case of semi-permanent structures, such as buildings of types 1, 2, and 3 as classified under the National Building Code of the Philippines, concrete/asphalt roads, concrete river control, drainage, irrigation lined canals, river landing, deep wells, rock causeway, pedestrian overpass, and other similar semi-permanent structures:] Five (5) years.
	[In case of other structures, such as bailey and wooden bridges, shallow wells, spring developments, and other similar structures:] Two (2) years.
10	Dayworks are applicable at the rate shown in the Contractor's original Bid.
13	The amount of the advance payment is no more that fifteen percent (15%) of the Contract Price subject to approval by the HOPE and compliance with the conditions under RA 9184 and its IRR.
14	No further instructions.
15.1	The date by which operating and maintenance manuals are required is thirty (30) days The date by which "as built" drawings are required as part of final payment
15.2	The amount to be withheld for failing to produce "as built" drawings and/or operating and maintenance manuals by the date required is ten (10%) percent of the contract price.

Section VI. Specifications

Notes on Specifications

A set of precise and clear specifications is a prerequisite for Bidders to respond realistically and competitively to the requirements of the Procuring Entity without qualifying or conditioning their Bids. In the context of international competitive bidding, the specifications must be drafted to permit the widest possible competition and, at the same time, present a clear statement of the required standards of workmanship, materials, and performance of the goods and services to be procured. Only if this is done will the objectives of economy, efficiency, and fairness in procurement be realized, responsiveness of Bids be ensured, and the subsequent task of bid evaluation facilitated. The specifications should require that all goods and materials to be incorporated in the Works be new, unused, of the most recent or current models, and incorporate all recent improvements in design and materials unless provided otherwise in the Contract.

Samples of specifications from previous similar projects are useful in this respect. The use of metric units is mandatory. Most specifications are normally written specially by the Procuring Entity or its representative to suit the Works at hand. There is no standard set of Specifications for universal application in all sectors in all regions, but there are established principles and practices, which are reflected in these PBDs.

There are considerable advantages in standardizing General Specifications for repetitive Works in recognized public sectors, such as highways, ports, railways, urban housing, irrigation, and water supply, in the same country or region where similar conditions prevail. The General Specifications should cover all classes of workmanship, materials, and equipment commonly involved in construction, although not necessarily to be used in a particular Works Contract. Deletions or addenda should then adapt the General Specifications to the particular Works.

Care must be taken in drafting specifications to ensure that they are not restrictive. In the specification of standards for goods, materials, and workmanship, recognized international standards should be used as much as possible. Where other particular standards are used, whether national standards or other standards, the specifications should state that goods, materials, and workmanship that meet other authoritative standards, and which ensure substantially equal or higher quality than the standards mentioned, will also be acceptable. The following clause may be inserted in the SCC.

Sample Clause: Equivalency of Standards and Codes

Wherever reference is made in the Contract to specific standards and codes to be met by the goods and materials to be furnished, and work performed or tested, the provisions of the latest current edition or revision of the relevant standards and codes in effect shall apply, unless otherwise expressly stated in the Contract. Where such standards and codes are national, or relate to a particular country or region, other authoritative standards that ensure a substantially equal or higher quality than the standards and codes specified will be accepted

subject to the Procuring Entity's Representative's prior review and written consent. Differences between the standards specified and the proposed alternative standards shall be fully described in writing by the Contractor and submitted to the Procuring Entity's Representative at least twenty-eight (28) days prior to the date when the Contractor desires the Procuring Entity's Representative's consent. In the event the Procuring Entity's Representative determines that such proposed deviations do not ensure substantially equal or higher quality, the Contractor shall comply with the standards specified in the documents.

These notes are intended only as information for the Procuring Entity or the person drafting the Bidding Documents. They should not be included in the final Bidding Documents.



Republic of the Valleymus Quezon City

CITY ENGINEERING DEPARTMENT



Civic Chater Building & Quezon City Hall Composed Efunt and Road Oilman, Central 1100 Quezon City Trunk line 163 2 8988 4242

TECHNICAL SPECIFICATIONS

QUEZON CITY INFRASTRUCTURE PROJECT

PROJECT TITLE:

PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE

ELEMENTARY SCHOOL -

LOCATION:

BARANGAY STA. MONICA, DISTRICT 5, QUEZON CITY

GR. GENERAL REQUIREMENTS

- a. Comply with the current and existing laws, ordinances and applicable codes, rules and regulations and standards. Any works perform contrary to the existing laws, rules and regulations, ordinances and standards without notice shall bear all cost arising therefrom.
- Drawings, specifications, codes and standards are minimum requirements. Where requirements differ, the more stringent apply.
- Should there be any change(s) in drawings or specifications, it is required to comply with the governing regulations inotify the implementing agency.
- d Photographs shall be taken as, when and where orrected at intervals of not more than one month. The photographs shall be sufficient in number and location to record the exact progress of the works. The photographs shall be retained and will become the property of the Government.
- Site confication / inspection shall be conducted to validate the scope of works. No extra compensation and extension of time shall be given due to negligence or inadvertence.
- f. The quality of materials shall be of the best grade of their respective kinds for the purpose. The work shall also be performed in the best and most capable manner in strict accordance with requirements of the plans and details. All materials not conforming to the requirements of these specifications shall be considered as defective.
- a. All equipment and installations shall meet or exceed minimum requirements of the standards and codes
- Mobilization and Demobilization (4 applicable)
 - i Mobilization shall include all activities and related costs for transportation of personnel equipment, and operating supplies to the site; establishment of offices, buildings, and other necessary general facilities for the operations at the site.
 - ii Demobilization shall include all activities and costs for transportation of personnel equipment and supplies not anymore required within the construction sits including the disassembly removal and site clean-up of offices and other facilities assembled on the site specifically for this contract.
- Execute work in strict accordance with the best practices of the trades in a thorough substantial, workmanlike manner by competent workmen. Provide a competent experienced, full-time supervisor who is authorized to make decisions on behalf of the Contractor.
- Temporary Facilities and Utilities
 - All facilities shall be near the job site, where necessary and shall conform to the boot standard for the required types.

- Temporary facilities shall be provided and maintained including sanitary facilities, and first aid stations.
- Temporary utilities shall be sufficiently provided until the completion of the project such as water, power and communication.
- Temporary enclosure shall be provided within the construction site with adequate guard lights, railings and proper signages.
- Temporary roadways shall be constructed and maintained to sustain loads to be carried on them during the entire construction period.
- Upon completion of the work, the temporary facilities shall be demolished, hauledout and disposed property.
- Adequate construction safety and health protection shall be provided at all times during the execution of work to both workers and property.
 - A fully trained Medical Aide shall be employed permanently on the site who shall be engaged solely from medical duties.
 - ii The medical room shall be provided in waterproof, it could be a building or room designated and used exclusively for the purpose and have a floor area of at least 15 square meters and a glazed window area of at least 2 square meters.
 - tile. The location of the medical room and any other arrangements shall be made known to all employees by posting on prominent locations suitable notices in the site.
 - Additional safety precautions shall be provided in the observance of pandemic Protocols set-forth by the government shall be strictly followed.
- Necessary protections to the adjacent property shall be provided to avoid untoward incidents / accidents.
- m Final cleaning of the work shall be employed prior to the final inspection for certification of final acceptance. Final cleaning shall be applied on each surface or unit of work and shall be of condition expected for a building cleaning and maintenance program.

SW. SITE WORKS

- A All grades, lines, levels and dimensions shall be verified as indicated on the plans and details. Any discrepancies or inconsistencies shall be reported before commencing to work.
- B. Removal / demolition of existing structures shall be done in accordance to safety procedures

CWIS. CIVIL / STRUCTURAL WORKS

CWSC. CONCRETE WORK

- a Delivery, Storage, and Handling: All materials shall be so delivered, stored, and handled as to prevent the inclusion of foreign materials and the damage of materials by water or breakage. Package materials shall be delivered and stored in original packages until ready to be used. Packages or materials showing evidence of water or other damage shall be rejected.
- b Unless otherwise specified herein concrete works shall conform to the requirements of the ACI Building Code. Full cooperation shall be given on trades to install embedded items. Provisions shall be made for setting items not placed in the forms. Before concrete is placed, embedded items shall have been inspected and tested for concrete aggregates and other materials shall have been done.
- c. Materials

- Cement for concrete shall conform to the requirements of specifications for Portland Cement (ASTM C = 150).
- ii. Water used in mixing concrete shall be clean and free from other injunous amounts of oils, acids, alkaline, organic materials or other substances that may be deleterious to concrete or steel.
- iii. Fine aggregates shall be beach or over sand conforming to ASTM C33, "Specification for Concrete Aggregates". Sand particle shall be course, sharp, clean free from salt, dust, loam, dirt and all foreign matters.
- Iv. Coarse aggregates shall be either natural gravel or crushed rock conforming to the "Specifications for Concrete Aggregates (ASTM C33). The minimum size of aggregates shall be larger than one fifth (1/5) of the narrowest dimensions between sides of the forms within which the concrete is to be cast nor larger than three fourths (3/4) of the minimum clear spacing between reinforcing bars or between reinforcing bars and forms.

d. Proportraning and Mixing

Proportioning and mixing of concrete shall conform to the requirements for Item.
 405 of the standard specification with the following proportions:

Cement: Sand Gravel

- Class 'A' 1 2 3
- Class 'B' 1 2 4
- Class "C" 1 , 2 ½
- ii Concrete mixture to be used for concrete shall conform with the structural requirements.
- ii. Mixing concrete shall be machine mixed. Mixing shall begin within 30 minutes after the cement has been added to the aggregates.

e. Forms

- i. General Forms shall be used whatever necessary to confine the concrete and shape it to the required lines, or to insure the concrete of contamination with materials caving from adjacent, excevated surfaces. Forms shall have sufficient strength to withstand the pressure resulting from placement and vibration of the concrete, and shall be maintained rigidly in correct position. Forms shall be sufficiently tight to prevent loss or mortal from the concrete. Forms shall be 'X' waterproof plywood and form lumber.
- Cleaning of Forms before placing the concrete, the contact surfaces of the formed half be cleaned of encrustations of mortar, the grout or other foreign material.
- iii. Removal of Forms forms shall be removed in a manner which will prevent damage to the concrete. Forms shall not be removed without approval. Any repairs of surface imperfections shall be formed at once and airing shall be started as soon as the surface is sufficiently hard to permit it without further damage.

Placing Reinforcement

Steel reinforcement shall be provided as indicated, together with all necessary wire bies, chairs, spacer supported and other devices necessary to install and secure the reinforcement properly. All reinforcement, when placed, shall be free from loose, flaky rust and scale, oil grease, clay and other coating and folleryn substances that would reduce or destroy its bond with concrete. Reinforcement shall be placed accurately and secured in place by use of metal or concrete supports, spacers and ties. Such supports shall be used in such manner that they will not be exposed or contribute in any way, to the discoloration or deterioration of the concrete.

g. Conveying and Placing Concrete:

DED2022_0229 RN: 22:05132

- Conveying concrete shall be conveyed from mover to forms as repidly as applicable, by methods which will prevent segregation or loss of ingredients. There will be no vertical drop greater than 1.5 meters except where suitable equipment is provided to prevent segregation and where specifically authorized.
- ir. Placing concrete shall be worked readily into the corners and angles of the forms and around all reinforcement and imbedded items without permitting the material to segregate, concrete shall be deposited as close as possible to its final position in the forms so that flow within the mass does not exceed two (2) meters and consequently segregation is reduced to a minimum near forms or embedded items, or elsewhere as directed, the discharge shall be so controlled that the concrete may be effectively compacted into horizontal layers not exceeding 30 centimeters in depth within the maximum lateral movement specified.
- iii Time interval between mixing and placing. Concrete shall be placed before initial set has occurred and before it has contained its water content for more than 45 minutes. Yo concrete mix shall be placed before 60 complete revolution of the machine mixer.
- iv. Consolidation of Concrete concrete shall be consolidated with the aid of mechanical vibrating equipment and supplemented by the hand spading and tamping. Vibrators shall not be inserted into lower cursed that have commenced initial set; and reinforcement embedded in concepts beginning to set or already set shall not be disturbed by vibrators. Consolidation around major embedded parts shall by hand spading and tamping and vibrators shall not be used.
- v. Placing Concrete through reinforcement In placing concrete through reinforcement, care shall be taken that no segregation of the coarse aggregate occurs. On the bottom of beams and slabs, where the congestion of steel near the forms makes placing difficult, a layer of mortar of the same cement-sand ratios as used in concrete shall be first deposited to cover the surfaces.

b. Guring

- General All concrete shall be moist cured for a period not less than seven (7)
 consecutive days by an approved method or combination applicable to local
 conditions.
- ii Moist Curing The surface of the concrete shall be kept continuously wet by covering with buriap plastic or other approved materials thoroughly saturated with water and keeping the covering spraying or intermittent hosing.

i Finishing

- Concrete surfaces shall not be plastered unless otherwise indicated. Exposed concrete surfaces shall be formed with plywood, and after removal of forms, the surfaces shall be smooth, true to line and shall present or finished appearance except for minor defects which can be easily repaired with patching with coment mortar, or can be grounded to a smooth surface to remove all joint marks of the form works.
- ii. Concrete Slabs on Fill. The concrete slabs on fill shall be laid on a prepared foundation consisting of sub grade and granular fill with thickness equal to the thickness of the overlaying slab except when indicated.

EW. ELECTRICAL WORKS

A. CONDUITS, BOXES AND FITTINGS

A.1 This item shall consist of the furnishing and vistallation of the complete conduit work, consisting of electrical conduits; conduit boxes such as junction boxes, pull boxes, utility boxes, octagonal and square boxes, conduit fittings, such as couplings, locknuts and bushings and other electrical materials needed to complete the conduit roughing-in work of this project.

DED2022_0229 RN: 22-05132

- A.2 All materials shall be brand new and shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark.
- A.3 All works throughout shall be executed in the best practice in a workmanlike manner by qualified and experienced electricians under the immediate supervision of a duly licensed Electrical Engineer.
- A.4 The work to be done under this division of specifications consists of the fabrication, furnishing, delivery and installation, complete in all details of the electrical work, at the subject premises and all work materials incidental to the proper completion of the installation, except those portions of the work which are expressly stated to be done by other fields. All works shall be done in accordance with the rules and regulations and with the specifications.
- A 5 All lighting fixtures and lamps are as specified and listed on lighting fixture schedule.
- A.6 All grounding system installation shall be executed in accordance with the approved prans. Grounding system shall include building perimeter ground wires, ground rods clamps, connectors, ground wells and ground wire taps as shown in the approved design.
- A.7 All auxiliary systems such as telephone and intercom system, time clock system, firealarm system and public address/nurse's call/paging system installations shall be done in accordance with the approved design.
- A 8 Upon completion of the electrical construction work, the contractor shall provide all test equipment and personnel and to submit written copies of all test results.

A.9 The contractor shall guarantee the electrical installation are done and in accordance with the approved plans and specifications. The contractor shall guarantee that the electrical systems are free from all grounds and from all defective workmanship and materials and will remain so for a period of one year from date and acceptance of works. Any defect shall be remadied by the Contractor at his own expense.

B. WIRES AND WIRING DEVICES

- This item shall consist of the furnishing and installation of all wires and wring devices
 consisting of electric wires and cables, wall switches, convenience receptacles, heavy
 duty receptacles and other devices shown on the approved Plans but not mentioned
 in these specifications.
- 2. Wires and cables shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark. Unless specified or indicated otherwise, all power and lighting conductors shall be insulated for 600 volts. All wires shall be copper, soft drawn and annealed, smooth and of cylindrical form and shall be centrally located inside the insulation.
- 3. Conductors or wires shall not be drawn in conduits until after the cement paster is dry and the conduits are thoroughly cleaned and free from dirt and moisture. In drawing wires into conduits, sufficient slack shall be allowed to permit easy connections for fixtures, switches, receptacles and other wiring devices without the use of additional splices.
- 4. All conductors of convenience outlets and lighting branch circuit homerons shall be wred with a minimum of 3.5 mm in size. Circuit homerons to panelboards shall not be smaller than 3.5 mm but all homerons to panelboard more than 5.0 meters shall not be smaller than 5.5 mm. No conductor shall be less than 2 mm in size.
- 5 Alt wires of 14mm and larger in size shall be connected to panels and apparatus by means of approved type lugs or connectors of the solderless type, sufficiently large enough to enclose all strands of the conductors and securely fastened. They shall not loosen under vibration or normal strain.

- All joints, taps and splices on wires larger than 14 mm shall be made of suitable
 solderless connectors of the approved type and size. They shall be taped with rubber
 and PVC tapes providing insulation not less than that of the conductors.
- 7. No splices or joints shall be permitted in either feeder or branch conductors except within outlet boxes or accessible junction boxes or pull boxes. All joints in branch circuit wiring shall be made mechanically and electrically secured by approved splicing devices and taped with rubber arid PVC tapes in a manner which will make their insulation as that of the conductor.
- 8. All walt switches and receptacles shall be fitted with standard Bakelite face plate covers. Device plates for flush mounting shall be installed with all four edges in continuous contact with finished wall surfaces without the use of coiled wire or similar devices. Plaster filling shall not be permitted. Plates installed in wet locations shall be desketed.
- When more than one switch or device is indicated in a single location, gang plate shall be used.

C. POWER LOAD CENTER, SWITCHGEAR AND PANELBOARDS

- C.1 This item shall consist of the furnishing and installation of the power load center unit substation or low voltage switchgear and distribution panelboards at the location shown or the approved Plans complete with transformer, circuit breakers, cabinets and all eccessories, completely wired and ready for service.
- C.2 All materials shall be brand new and shall be of the approved type meeting all the requirements of the Philippine Electrical Code and bearing the Philippine Standard Agency (PSA) mark
- C.3 Power Load Center Unit Substation, The Contractor shall furnish and install an indoortype Power Load Center Unit Substation at the location shown on the approved Plans if required. It shall be totally metal-enclosed, dead front and shall consist of the following coordinated component parts:
 - C 3.1 High Voltage Primary Section. High voltage primary incoming line section consisting of the following parts and related accessories:
 - i. One (1) Air-filled Interrupter Switch, 2-position (open-close) installed in a suitable air filled metal enclosure and shall have sufficient interrupting capacity to carry the electrical load. It shall be provided with key interlock with the cubicle for the power fuses to prevent access to the fuses unless the switch is open.
 - Three (3)-power fuses mounted in separate compartments within the switch housing and accessible by a hinged door.
 - iii. One 1) set of high voltage potheads or 3-conductor cables or three single conductor cables.
 - iv. Lightning arresters shaft be installed at the high voltage cubicle if required.

Items (i) and (ii) above could be substituted with a power circuit breaker with the correct rating and capacity

Transformer Section. The transformer section shall consist of a power transformer with ratings and capacities as shown on the plans. It shall be oil liquid-filled nonflammable type and designed in accordance with the latest applicable standards.

The transformer shall be provided with four (4) approximately 2 1/2 % rated KVA taps on the primary winding in most cases one (1) above and three (3) below rated primary voltage and shall be changed by means of externally gang-operated

manual tap changer only when the transformer is de-energized. Tap changing under load is acceptable if transformer has been so designed.

The following accessories shall be provided with the transformer, namely, drain valve, sampling device, filling connection, cilliquid level gauge, ground pad, top filter press connection, tifting lugs, diagrammatic nameplate, relief valve, thermometer and other necessary related accessories.

The high-voltage and low-voltage bushings and transition flange shall be properly coordinated for field connection to the incoming line section and low voltage switchboard section, respectively

- c. Low Voltage Switchboard Section. The low-voltage switchboard shall be standard modular-unitized units, metal-built, dead front, safety type construction and shall consist of the following.
 - i. Switchboard Housing. The housing shall be heavy gauge steel sheet, dead front type, gray enamel finish complete with frame supports, steel bracings, steel sheet panelhoards, removable rear plates, copper busbars, and all other necessary accessories to insure sufficient mechanical strength and safety it shall be provided with grounding bolts and clamps.
 - ii. Secondary Metering Section. The secondary matering section shall consist of one (1) anymeter, AC, indicating type; one (1) voltmeter, AC, indicating type, one (1) anymeter transfer switch for 3-phase; one (1) voltmeter transfer switch for 3-phase; and current transformers of suitable rating and capacity

The above-mentioned instruments shall be installed in one compartment above the main breaker and shall be complete with all necessary accessories completely wired, ready for use.

iii. Main Circuit Breaker. The main circuit breaker shall be draw-out type, manually or electrically operated as required with ratings and capacity as shown on the approved Plans.

The main breaker shall include insulated control switch if electrically operated, manual trip button, magnetic tripping devices, adjustable time overcurrent protection and instantaneous short circuit trip and all necessary accessories to insure gate and efficient operation.

iv. Feeder Circuit Breakers. There shall be as many feeder breakers as are shown on the single line dragram or schematic riser diagram and schedule of loads and computations on the plans. The circuit breakers shall be drawout or molded case as required. The circuit breakers shall each have sufficient interrupting capacity and shall be manually operated complete with trip devices and all necessary accessories to insure safe and efficient operation. The number, ratings, capacities of the feeder branch circuit breakers shall be as shown on the approved Plans.

Circuit breakers shall each he of the indicating type, providing 'ON' - "OFF and "TRIP" positions of the operating handles and shall each be provided with nameplate for branch circuit designation. The circuit breaker shall be so designed that an overload or short on one pole automatically causes all poles to open.

- d. Low Voltage Switchgear (For projects requiring low-voltage switchgear only). The Contractor shall furnish and install a low-voltage switchgear at the location shown on the plans. It shall be natal-clad, dead front, free standing, safety type construction and shall have copper bushars of sufficient size, braced to resist allowable root mean square (RMS) symmetrical short circuit stresses, and all necessary accessories. The low-voltage switchgear shall consist of the switchgear housing, secondary metering, main breaker and feeder branch circuit.
- Grounding System, All non-cultient carrying metallic parts like conduits, cabinets
 and equipment frames shall be properly grounded in accordance with the
 Philippine Electrical Code, latest edition

The size of the ground rods and ground wires shall be as shown on the approved. Plans. The ground resistance shall not be more than 5 ohms.

f. Panelboards and Cabinets. Panelboards shall conform to the schedule of panelboards as shown on the approved Plans with respect to supply characteristics, rating of main lugs or main direuit breaker, number and ratings and capacities of branch circuit breakers.

Panelboards shall consist of a factory completed: dead front assembly mounted in an enclosing flush type cabinet consisting of code gauge galvanized sheet steel box with trim and door. Each door shall be provided with catch lock and two (2) keys. Panelboards shall be provided with directories and shall be printed to indicate load served by each circuit.

Panelboard cabinets and trims shall be suitable for the type of mounting shown on the approved Plans. The inside and outside of panelboard cabinets and trims shall be factory painted with one rust-proofing primer coat and two thish shop coats of pearl gray enamel paint

Main and branch circuit breakers for panelboards shall have the rating, capacity and number of poles as shown on the approved Plans. Breakers shall be thermal magnetic type. Multiple breaker shall be of the common trip type having a single operating handle. For 50-ampere breaker or less, it may consist of single-pole breaker permanently assembled at the factory into a multi-pole unit.

C.4 The Contractor shall install the Power Load Center Unit Substation or Low-Voltage Switchgeer and Panelboards at the locations shown on the approved Plans

Standard panels and cabinets shall be used and assembled on the job. All panels shall be of dead front construction furnished with trims for flush or surface mounting as required.

- D Comply with the current applicable codes, ordinances, and regulations of the authority or authorities having jurisdiction, the rules, regulations and requirements of the utility companies (as applicable).
- E. Drawings, specifications, codes and standards are minimum requirements. Where requirements differ, the more stringent apply.
- F. All equipment and installations shall meet or exceed minimum requirements of the Standards and Codes.
- G. Execute work in strict accordance with the best practices of the trades in a thorough substantial, workmanlike manner by competent workmen.
- H. When the tests and inspections have been completed a label shall be attached to all devices tested. The tabel shall provide the name of the testing company, the date the tests were completed, and the initials of the person who performed the tests.

I. PANELBOARDS

- Fabricate and test panelboards according to IEEE 344 to withstand seismic forces defined in Division 16 Sections 16073 and 16074 "Hangers and Supports for Electrical Systems and Vibration and Seismic controls for Electrical Systems" respectively.
- 12 Enclosures. Flush, Surface, Flush- and surface-mounted cabinets.
 - 1.2.1 Rated for environmental conditions at installed location.
 - Indoor Dry and Clean Locations: NEMA, Type 1.
 - Outdoor Locations* NEMA, Type 3R.
 - ψ. Kitchen and Wash-Down Areas. NEMA, Type 4X, stainless steel


- iv. Indoor Locations Subject to Dust, Falling Dirt, and Dripping Noncorresive Liquids: NEMA Type 12
- Outdoor Locations Subject to Dust, Falling Cirt, and Dripping.
 Noncorrosive Liquids: NEMA Type 5R.
- 1.2.2 Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box.
- 1.2.3 Hinged Front Cover: Entire front trim hinged to box and with standard door within hinged from cover.
- 1.2.4 Skirt for Surface-Mounted Panelboards: Same gauge and finish as panelboard front with flanges for attachment to panelboard, wall, and ceiling or floor.
- 1.2.5 Gutter Extension and Barrier Same gage and finish as panetboard enclosure integral with enclosure body. Arrange to isolate individual panel sections.
- 1.2.6 Finishes
 - Panels and Trim: Steel and galvanized steel, factory finished immediately
 after cleaning and pretreating with manufacturer's standard two-cost,
 baked-on finish consisting of prime cost and thermosetting topodat.
 - Back Boxes: Galvanized steel Same finish as panels and trim
 - Fungus Proofing: Permanent fungicidal treatment for evercurrent protective devices and other components.
- 1.2.7 Directory Caro: Inside panelboard door, mounted in transparent card holder metal frame with transparent protective cover.
- 1.3 Incoming Mains Location. Top or Bottom
- 1.4 Phase, Neutral, and Ground Buses.
 - [.4.1 Material: Hard-drawn copper, 98 percent conductivity
 - 1.4.2 Equipment Ground Bus: Adequate for feeder and branch-circuit equipment grounding conductors; bonded to box.
 - 14.3 Neutral Bus: 100 percent of phase bus 4. Extra-Capacity Neutral Bus: Neutral bus rateo 200 percent of phase bus and UL listed as suitable for nonlinear loads.

JONATHANIL, DEDA CRUZ Planning and Programming Division CJOCELYN A. NAONG
Planning and Programming Division

Page 9 of 9

Section VII. Drawings

[Insert here a list of Drawings. The actual Drawings, including site plans, should be attached to this section, or annexed in a separate folder.]

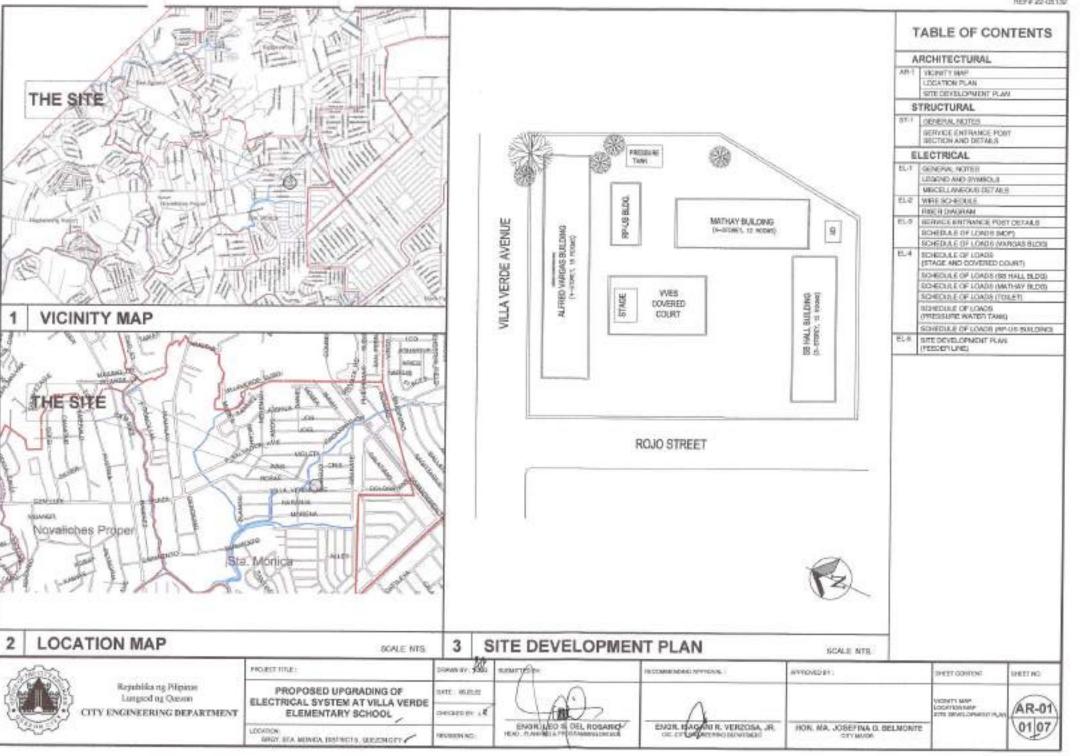

- ALIWARD BALL DE DEDUKTE AND DESERVE SE SAN LEDIN REPORT DE SAN RECORDE DE SAN LEDIN DE HIGHTINES. THE HIN TORN, TORNIS DOES OF THE PHILEPPINES WAS STREET PROJECTIONS AND PROPERTY.
- ALL MORE EDGE, BY ELAPOVINE OF A SCIPLIFICATION OF ENGLISH OF THE ACT OF SCIENCE PROPERTY AND ALL MORE EDGE. BY ACCORDING WHICH THE RESIDENCE FRANCE SCIPLIFICATION OF CHIEF OF S. R. SHIP SEQUENCES AND ADMINISTRATION OF THE ACT OF T
- All REPORTED REPORTS SALES AS SECURED AND RESIDENCE AS SECURED

- AL CREMENT CONTRACTOR SECURITION FOR A SECURITION OF A CONTRACTOR SECURITION OF A CONTRACTOR SECURITION OF A CONTRACTOR SECURITIES AND A CONTR

 FORES AND SCAFFOURIES
 191 PRODUCT ASSOCIATE SHOWN ASSOCIATION TO A PRODUCT A STATE OF THE STATE THE WOORDY SHOULD ESTIMATED HE WASHINGTO PROPERTY OF SAME CREDITY FOR MICHIGAN CREATED.

CONCRETE MAS PERMONENTATION

THE ALL ODDINGS WALL SOCIOUS AREA BECOMING A PROCESS OF THE ENGINEERING THE OR OF DRIVING WITH

100004	1,80%	Allomores	MAX. BUAIF
# GADON GRADE SUREL PAROMENTS. WINA PERTANG.	(000 PS(2) MHz	To (See	411,000,000
S RANK TO LINE SUPPLIES S.AS. COLUMN FOR Mag	entrication	bracens	241,19840

THE REPORTED BASED HAVE BEEN CONFORM TO PROJECT AND STREET, FOR THE REPORT AND SHELDS SAVE AND UNION PER PROPERTY THAN DIVIDE AND LABOUR SHIP.

THE RAPP WE WHEN AN OWN PET CONSTRUCTION DESCRIPTION. THE PETER SHIP AND AND ADDRESS OF THE PETER SHIP ADDRESS OF

CONTROL CHPCOMIC BRIEFS, Y 404861 (SIGLAGE	70 mm
1.59TH050 SAN	No.
EAST-STATE	(40 tel
MALE ANNE SINGS:	Ji iyi
MPAGE COLUMN	\$1 m

11-5 AG AND RECEIVES SENTER HER DEMONSTRATIONAL HE PROPERTY FRANCISCO HER SECURED HER AND PROPERTY.

III. Aut CHRIST DE BELLOT HOTT BOST FORT E REVENUOUS BOVERED DIVE DE LA CESTRE BOURD DE LE CONTROL DE LE CONTROL DE LA CESTRE POUR DE LA CESTRE DE CONTROL DE LA CESTRE DE

HEND	CLReek for
PERBOTON	\$1100
BEYFERCIED BLAB EDUCT SAIDS BECK BING LOGS HET MYSSE	Hatti
DX:0000 4 SALL	9000
N/HZ	11,845

- BIT HE THEOTHER BRITE THE CONFORM TO ATTH HIM, SHEDHOW ONE WITH BRANCH FREE OF HEAVY AND RECEIVED AND RECEIVE
- THE WELDING RODS ALL WELDING RODS INVESTIGATION OF THE CONTROL LOW PROPORTIES FOR ANY IN MINISTRAÇÃO ESPECIAL ESMAN

FO. COMMUNICAL

- FORMONICAE DESCRIÇÃO INICIDADO MINIMA BARDARO CODE OF FIRE PHARMADISTRALAMAÇÃO MINIMADO DA BARDARO COMPAÑANTO O PREMA PROPREMA DESCRIÇÃO ANALYZÃO DE HINADA CONTRACTOR DE HINADA CONTRACT

- HI I MORNAL ORGATIONAL CORDS & MINORIT SHIP CONTON A VIOLENCE THE REGIONAL AND RESIDENCE OF
- BOYLYBRORD CTURES COMPRISE CRESCULT TO MA DOUGH.


 HE ALD BEAUGE LAS CLIMB OF WEIGHT BURGET THE WAYNER CONTINUTY AS CRESS SUCCESS.

- WITH A THROUGH THE LIGHT TO PROVIDE AN ENGINEER HAVE THE THROUGH THE PROVIDE A HEAVY THROUGH THE PROVIDE A HEAVY THROUGH THE THROUGH THE THROUGH THROU







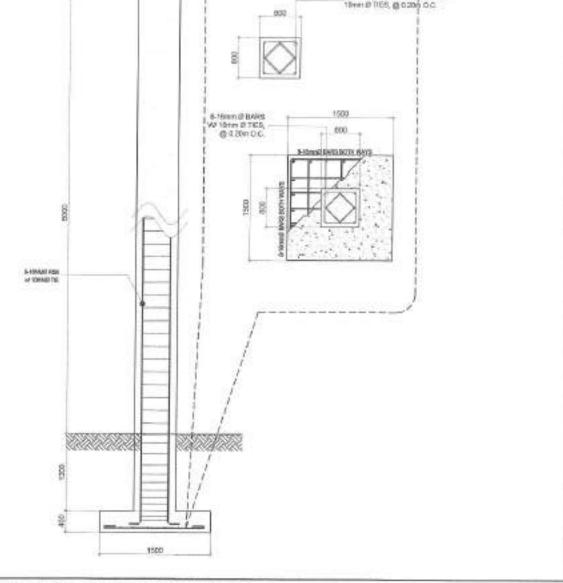

GENERAL NOTES

SCALE MIS.

doxion:

SERVICE ENTRANCE POST SECTION AND DETAILS

SCALE NTS. IRRET NO



Republika ng Pilipinas. Lungsod ng Osevon CITY ENGINEERING DEPARTMENT

PROSECUTIVE: PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE ELEMENTARY SCHOOL

SAGY, STA. REINICA, BREWCTA, GESTEVOTTS

ERTE: 00.05.02 N. Watered REVENUE NO.

CONNECT POR

ENGR. LED S. DEL ROSARIO

ENGR. IRAGINI R. VERZOSA, JR.

RECOMMERCIAL REPORTS.

REMORAL INTERA DEPOSE FATROACE POST SECTION (U.S.) HOW MA JOSEFINA G. BELMONTE DEFEMANCE

SARE CONTRACT

APPROVED BY

B. HAVE BY YEAT CAL BURS W.

ST-01 02 07

- ALL MORKS SHALL BE EXECUTED INVICORDANCE TO THE LATEST EDITION OF THE PHILIPPINE ELECTRICAL CODE, PHILIPPINE SUBCRITICISCS CODE, THE ANTICINAL BUILDING CODE OF THE RHAPPINESS AND CODES RELATED LAWS AND ORDINAMOES OF THIS EIT?
- ALL WORKS SHILL BE SUPERVISED BY A REQUIREMED PROFESSIONAL RELATED TO THE ACTIVITIES BEING
- ALL WORKS SHALL BE COOKDINATED WITH THE RESPONTIVE TRADES SO TO AVOID CONFLICTS QUARMS. EXPOURON OF ACTIVITIES.
- ALL NECESSARY PETRITS SHALL BE DECLIBED AND TURNED-ONER TO THE CITY.
- ALL DRIVANGES AND SPECIFICATIONS SHALL BE CONNECTLY INTRODUCED THE CONTRACTOR WILL SHALL MARIDIATELY HE INFORMED IF DESCRIPTION (EXILYGLAD HEREIS)
- ALL DIMONICORD, ELEVATIONS AND REFERENCES, SHALL SE VEST ED WITH THE ACTUAL CONDITION PRIOR
- THOP DIMMINGS SHALL BE INVOICED AS RECESSARY PROOF TO THE EXECUTION.
- ALL MORRS SHALL BE TESTED AND COMMISSIONED AS INDICATED IN THE SPECIFICATIONS WITH THE PRESENCE OF ALL PARTIES INVOLVE-PESSED IS BOOK I BE DISCLARRITED PROPERLY
- ALL PIPCS AND LAYOUR ARE SHET DANFAMBATIC, ACTUAL LAYOUT OF FIRE AND RITTINGS LINESES. OTHERWISE REQUIRED SHALL BE PROPERTY CONSTAURD.
- ID. HO MPET EHALL BE ALL DIEST TO BE EMBEDDED IN STRUCTURAL HE MEDTS. LINE DOS OTHERWISE
- 11. ALL PIPES, PITTINGS, EDUPMENT AND PAYURED GHALL BE NOTHLED IN ACCORDANCE TO HAMLIFACTURERS SPECIFICATIONS AND INJURIEUCITORIE
- SUPPORTS AND WASHINGERS SHALL BE PROVIDED ADDORSHOLY.
- CL. ALL COMPRENTS AND FUTURES SPACE BE SWIFTSWISHTAN PROVIDE.
- 14. PUR MULATION OF BERNICH BYTHNICS.

IN I. THE TYPE OF INTRACE ENTRANCE SHALL BE SINCE PHAIR, THIS WIFE PLUE ORDURO, BOHERTZ,

THE THE REPORTS SHIPMANCE BOURFRIENT SHALL BE PROPERLY ORGANIZED IN ACCORDANCE WITH THE PHILIPPING ISLEGIFFICAL GODE.

143. THE MAIN OVERCORREST PROTECTION DECICE SHALL BE OF THERMAL WASHETIC MISSE IN INDIAN SW RICATHERPROOF ENCLOSURE.

- 15 WETALL ATTOMOR LIGHTING AND POWER SYNTRAL
 - 15.1. ALL LIGHTED AND COMMITTEICS CUTLET CRICITS ID-ALL RELIEVED AND THEVE WAS COPPER MADE. DELETE OTHERWISE NOTED MINISTER BY MAY SHALL BE 25 DO MM. COPTON WIRE, ALL WARDS AND DABLES SHALL BE GOLDR CODED AS FOLLOWS:

1.045.5 LINES BLACK NEWTON WHETE GROUND - CONTRA

ISS. ALL DISCOGO BRAKON OFICUTS SHALL BE PAY CONSULTS AND FOR ISOTORIC RETAILATION SHALL BE INC. SUPPORTED BY CONSULT CLAMPS RURHT TO RELIMITERS, MICCOR CONSULT HAVING RICEPROPTS. HURRY TRUSHED METHER.

THE CONDUCTORS NO CASE SHILL NOT BE MORE THAN THE EQUIVALENT OF YOUR QUARTER BENCOME. ANY ONE PLAN ALL CONDUCT BENCO SHALL BE TITLD WINDS BY USING HYDRIVALIC BENCOME. MINIMUM. DEMONG RADIUS MUST SE IN ACCORDANCE TO THE CODE AS DURING MET.

15.4. ALL POWER OUTLITS AND SWITCHES SHALL SE GROUPCING TYPE WITH PARKELIN, DLOTS FOR 250 V.

16.5. PROVIDE GROUND FALET CURRENT INTERREPTIN CIRCLIT BREAKEN FOR LOADS ANNUED SPOY ON

THE ALL METALLIC CONDUCTS, INVITATES, LIGHTING PRITURES, PANEL BOARDS, GOLUPINEITS AND NON-CUPPRENT CAPITY ING METAL PARTS GHALL BE PROPERLY SPOUNDED AND BOADED.

15.7, THE CROUND RESISTANCE SHALL WOT BE MORE THAN 5 (SHE).

15.6. ALL MOUNTING HEIGHTS FOR WALL MOUNTED DRIVICES SHILL HE AS POLICIES.

A. LIGHTING SHITCH - 1400 MAI ABOUG GLOOD DAIBH B. DOWNSMENCE OWNER 360 MM ABOVE FORCE FRESH 158MM AROW, WORKING COLADINA C. FAVELEGARD AND CARRETTS - 1400 MM ABOVE FLOOR TRAIN-

IS BOT LIGHT THE WILL TERP OF DESCRIANCE R. RIMPROPRIET LIGHT 2000 ABOVE PLOOR EMERGENCY

- THE PART MORES GHALL BE WHENEVER HELESSONSYTH FACILITIES WHE PULLER CASH FIRESE ARE
- THIS POR EXCHISIVES BRANCH GROUT IN PARELBOARD, PROVIDE CHESTIAM DAWNTER HAPT'S CONDUCT TERMINATED TO KOMM OCTADOW. BOX ABOVE CEILING, WINDOW SIZE OF PUBLISOR DHALL BE
- 12.3 KLL CHICLET REPARENCE SHALL BE BOLT KNATHYRE WITH SWEEKSLIFTING CHRACKY AS INDICATED IN THE PLANS PARELEDANDS SHALL BE GALVANZED SHELL PROBLED COATED SANE LENGUIS.
- HILA PERDOR AND BROKEN CROWN CONDUCTORS IN DABLE TRAVE SHALL BE DROWNED, BOXERD AND TARGED TO RESCATE CLEARLY THE ELECTRICAL CHARGES FOR SUCH AN CREEK HABBERT AND
- TALL REPORT TO RECOVERED A FUNDMENT AND FIRE PROTECTION DEVANDED FOR INCIDIOS AND LOCKTONS OF ROMPHENT AS HELL AS THEFT CONTROL SERRISHES AS SPECIFIED AND OR SHOWN UNDER THE MITTERS PROTING SECTIONS
- YES ALL HATERIALS TO BE LIKED AND THE GOLFMENT TO BE SIZEALISE IDNALLING OF THE WIRT CLIAITY, BEAUTINGWAS SPECIFIED IT MUST BE APPROVED TYPE FOR THE PARTICULAR LOCATION AND
- THE PROTOCOL OF A LABORATY SYSTEM (VOICE/DATA SYSTEM, GLOSLIC GROUT TELEVISION SYSTEM AND FIRE DETECTION ALAPM SYSTEMS
- HE I HALL ALOUE MIDY MICHIGG MAINT HAPPER TO WIRE SCHOOLS AS HIS CATEGORN ALAMS.

HE I MANAGEMENT GOT WITH THIS OF CONDUST SHALL BE AS FOLLOWS:

VOICE DATA BYE YES JOMM B PVC OCTYSY1806 SOMM BIPYC FING STREET HIMM IT EATTHIC

16 f. ALL EMBRECKED CHICAGN SHILL BE PAIC CONDUITS AND PORTEGROUD HISTALLATION SHALL BE ENTING SUPPORTED BY CONDUST QUARTE EYESTY TREMUMENERS AND/OR CONDUST HINGER SUPPORTS EYERY CODMILIVE TURS.

15 2. ALL MOLATING HEIGHTS FOR WHILL INDUNTED DEVICES BHAIL BE AS FOLLOWS:

TELEPHONE OUTLET - 302 Min ABOYE FLOOR FRISH OKTY OUTLET 300 MW ABOVE FLOOR FINES **CHITA CUTUET** SOMM A BOY'S VICKNISH COLBUTER. TAXISTON ARXIVE PLOCA PLANTA CHRISTS

16 1 BOXES WAS CULTIMAN STOLLOWING SHALL BE PARRICATED FROM STEEL WITH THE CHARGE AT PCIO, DWG.

MAX. WIDTH OF THE WORST

ELEPHANE STEEL

UP TO MEDICARD ISSUED AND AND ADDRESS. DAMES OF THE PROPERTY OF THE PARTY OF THE PA NAMED ENGLY AND TOPOGAL OVER 19240 MIN BUT NOT ORDINAST SE DA SEPAINTED WITH METAL. FIRMOR'S POXY AND TOPODAL

CHER 467.05 MM BUT HOT OVER THE HM 6/4 TE RAINTED WITH METAL PRIMER EPOSY KHO TOPCOMT OVER 352 MM

GA 18 RAINTEO WITH METAL PRIMER EPORY AND TOPOSAT

CAL

15.1 THE COMMUNICATION GROUND RESISTANCE SHALL NOT EXCEED 2 CHART.

cases ov HB


DATE: MISSE


M STATION


REVISION NO

15.2 ALL MATERIALS TO BE LIGHTLAND THE SOLDPRING TO BE RECTALLED SHALL BY OF THE REST COILLINY. BRAND NEW AS SPECIFIED. IT MUST BE APPROVED THE FOR THE PARTICULAR LOCATION AND

- Torus	(YOU - 100mm) FRESH LIVE.		DECRM DEFINITION PROF
-1	CONTINUE TO DIVISION OF THE PROPERTY OF THE PR	100	monent so it, bess wit
C33	PARIS, PSARE	2	SHISHOWS NO
	WHEE PORT	-0	STATE INTORES
6	SEEDBARY SHOP ORDAY SUPO	00	CLIWIT-HUP MICH
	PRIFESS SERVER STRAKE		

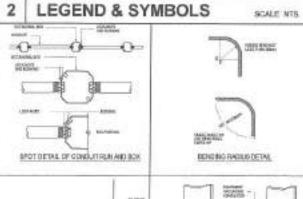

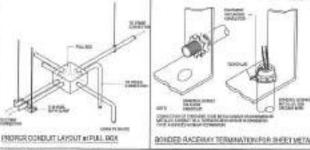



GENERAL NOTES

Republika ng Pilipinas Langsoding Queens CITY ENGINEERING DEPARTMENT

PROPOSED UPGRADING OF **ELECTRICAL SYSTEM AT VILLA VERDE** ELEMENTARY SCHOOL >

LOCKTON SPROV. SEA, MONICA, DEFENCTS, DEFECTIVE

FROJECT TITLE:

SCHOOL SECTION OF ENGR. LEO & DEL ROSARIO

HEAD TRANSPORTED PROGRAMMES THREE

ENGR. ISAG DE R. VERZOSA, JR.

PROCESSION APPROVAL

SCALE NTS

OIC-CITY OVERVIEWS REPAIRMENT

APPROVED BY

HOR. WA: JOSEF MA G. BELMONTE CITYMOTOR

MISCELLANEOUS DETAILS SCALE NES DEST CONTRA mental sec


COMMENS. NOTES

EL-01 WHEN SHOUND STORY BACOBING OWN GHISHS 03 07

WIRE	SIZI	E OF
CODE	WIRES	CONDUITS
X8.0	2-8.0mm ² THHN COPPER WIRE 1-5.5mm ² TW GROUND WIRE	IN 20mmø IMC PIPE
X30	2-30mm* THHN COPPER WIRE 1-8.0mm* TW GROUND WIRE	IN 32mm# PVC PIPE
X38	2-38mm ² THHN COPPER WIRE 1-14mm ² TW CROUND WIRE	IN 40mmø IMC PIPE
X50	2-50mm ² THHN COPPER WIRE 1-14mm ² TW GROUND WIRE	IN 50mmø IMC PIPE
Y175	3-175mm ² THHN COPPER WIRE 1-30mm ² TW GROUND WIRE	IN 80mmø RSC PIPE
F100	3-100mm* THW COPPER WIRE 1-30mm* TW GROUND WIRE	IN FREE AIR

1 WIRE SCHEDULE

SCALE NIS.

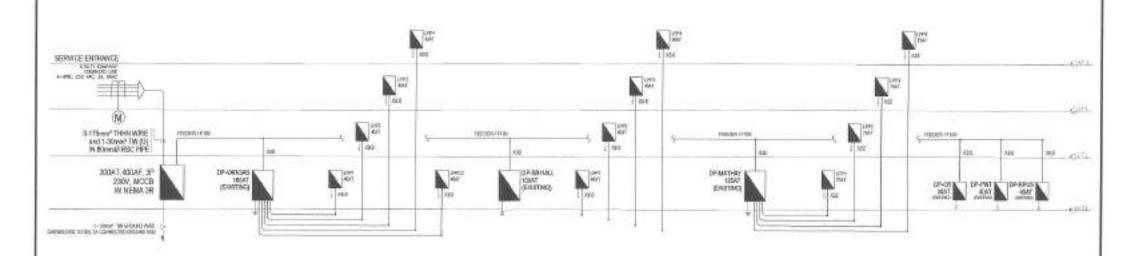

2 RISER DIAGRAM

SCALE NES

вност сонтом



Republika ng Pilipinan Languad ng Quezon CITY ENGINEERING DEPARTMENT PROPOSED UPGRADING OF
ELECTRICAL SYSTEM AT VILLA VERDE
ELEMENTARY SCHOOL

LOCATEM
BROY STA MONEA PETITICI N. CHEOMIST

FERSCHING




Λ
ENOR ISAGAR N. VERZOSA, JR.

AND PARTIES ASSESSED.

WRE SCHOOLE AND ORGANI
HON, BA. JOSEFIWA G. BELWONTE
OTHEROS

APPRINCEINY

EL-02 04 07

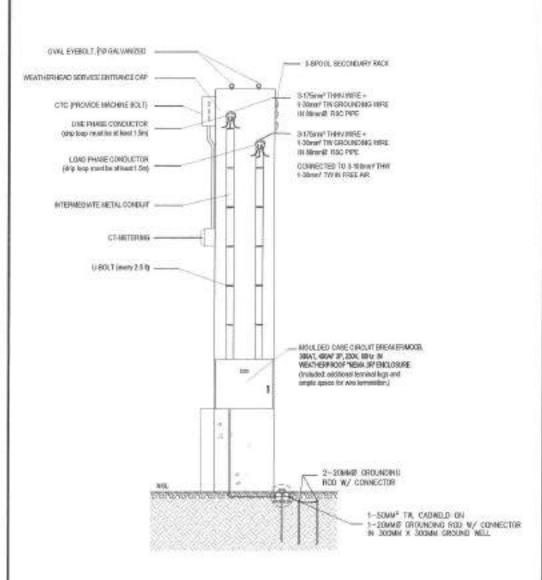

9110	viere.		007	comits come comment	0.00113		160	N/	1007	190381	10101000
717		1.0	.00	V-811 2-0-35 40.	- 45	CAC.		-	ANPEN	BEARS	
4	10.84		10.11.11	manuel in some	120.07				(304000	161007,78-10033	1. Moreov PM 66 v 1. Alterna TW 60 to Streenal AAC/ACA
- 10				CB, NOSE, NO 00096-0		94.31			191000	HOM, SE HOLE	2. House, present of regions, facilities and hard-late.
	286			MARK BAN SURE SPERU		0.0	68.47		1364000	TTWATTE RICER	4: How THR +1: Moon To \$6 to About NACAGE
4	286			Till Jester Mediters Rolp-I		13.04	-		500000	KINE, 95, 963	3 - 5 Smort William v 1 - 5 Smort for the trained electric to
1	381			PRETRUGE MAY ETC LANS.		11.62			344000	AUST AN NOOR	2 - 2 THE PAY THERE + 2 - 3 DESCRIPTION STONE ASSUMED MACHINE.
1	28V			STATE WATER			13.00		844000	-cost (0.560)	1 Billion THER CL S South By John Should RESTER
-	-		1931	E	Decr	200	pie.	1.30	HERO		

2 SCHEDULE OF LOADS (MDP)

Var 2 - Elizary Filtr + 1 - Street Tyl Blow HRE 18/7120

historian feather

SCALE NTS.

rade	Milera	OUTST.	OF MENT SAID STREET	- M	SHEEK LE	·	16	9041	SHOW	SIC CF VBIS
1790	200	\$8.1.540	AND CONTRACTOR	1.00	146	-	19	podete	19000	
1	381		2741	838				3909-00	ROAL BUNCOS	2 - Edward State - 1 - Little Constitution of Based No.
3	38		\$795 \$705	3030				1600-00 1600-00	SOIL PLACE	2 - 6 Step of 19 Mills + 1 - 6 Steady Toly (Clary Shapping Sal).
1	300		648	3430				5500-00	4007 (F), MOC 6	2. Ellipse Britton 1. Libert William Street Mc.
1	180		999 995	ASR ASR PAR				1000000	464E-95, MICO	C-10 there Weller 1-5 Stood 100 (DD) - Droved MC
1	200		3000	36.29				4890.00	408CHC8406	3 - Kilomed Shellfor 2 - 3 Depot City (Cyr.) Directly Add.
T.	330.		hose	-				70,000	100000000000000000000000000000000000000	
-		709	H.	28137	636	9.20	8.00	20300700		

11.60	Vacio.	111	TUT.	(September 1997)	- 65	# MED LO	HE-	40	VBD	00001	(All riches)
	1000	142	.60		- 10		- PK		MARKET	10000	
4	-044	£ .	200		2.600	11.25		1 3	500	teat at work to	1 - ESANY FREE - S - ESANY TRIPS IN ESANGERY
1.	29.0				1.16				400	15M-35 800-00	1-13mm* New York Toront Toront a Direct Print
-16	188				3,68				A00	- JIME JE Boli Chr	1 - Liner Telli - 1 - Charl Ty Cl a Line FVC
	180			F- DISE WA	5.4.9				700	DML 20 BORGS	2 - 3 South Tillettin in a - 3 South Phonais in a proposed trick.
	190			4 - CHINE SAA	3.12				110	EMF, W. Work Co.	\$ - 10000 FBRD > 1 - 12000 TWO IS BROKED PVC.
1	180				1.30				1000	1987-37-Rult Chr.	2 - 2.5 mm TMWH + 1 - 5.5 mm TMVCI to 15 mm2 PAC
T.	130				4.30				3000	4MF.3h Buls Co.	2 Theref Table 1 Theref Table is blood PAC
	300			tivité							
	-		1989	W.	1500	0.00	9.10	8.00	1000,09		

	SERVICE	ENTRANCE	POST	DETAILS
--	---------	----------	------	---------

SCALE NTS.

SCHEDULE OF LOADS (VARGAS BUILDING)

SCALE NIS.

0

Republika ng Pilipinas Langsod ng Queson CTTY ENGINEERING DEPARTMENT PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE ELEMENTARY SCHOOL

CONTROL OF STATE OF S

ENGIR. LEO B. CEL ROSANO.

ENOR, ISANA N. VERZOSA, JR.

LANCEPHA DECEMBERSORS

IR. HON, IKA, JOSEPINA G, BELMONTE

APPROVIDED BY

DETAILS DEVANCE PLANT COTTO CO DOMESTOR CO. LOWIS

THEFT CONTENT

EL-03 05 07

er wa	reserve a		1.01	TERRITORIA MINETO		10,000		-10	1637	186537	Morrow
- TY		+4	100		196	-94	- 60	-	min 44 14	MACALIN .	
1	199.1	9.		1-70/00 april	91/9				-800	SOME, SP, Brotholis	L. Alfred Weller S. Eponet Will part during the
3.	191	- 3		4 - F(C)(30) (60 F)	11/9				DIE	BMIDS WIND	E-5289 (MRH-1) LIMIN TRUMS (MINER PE
- 10	130		4	1-0891998	129				(266	340.35 lb 0.65	To Albert 1988 CA. Albert TW Mile Street Pill
	100			1-ORRITARY	6.76				1000	State of Bull St.	E. Albard Dileit v. S. S. Sant Vis. Size, Strong Print
5	198			1 hips							
	110			1103							
	1000		700		04/79	630	100	9.00	100.00		
			67130 -		1						

PORT OF THE MOVE THE LAW STREET Miles I wert weeks, 25, 3,000, 50000 STREET, STREET, 作 (A) 原 MORE E-Street Wester L. E. Street For Stone Journal Print #45.053E 1331 891 630 430 C+ MRITHE + THE 2-STREET PRINTED BY STREET PARTIES AND ADDRESS OF THE PARTIES AND ADDRE

SCHEDULE OF LOADS (STAGE & COVERED COURT) SCALE MISS.

160	441.44	Dec	MI	THREE PARTIES.	. 04	PROB 11	+6	86	168	10000	10 7 990
-	100.00	- 10	.10		- 68	100	-	-	MANAGE.	antisets.	
	1111	- 32	2000		298	1777			900	2007, 35, 76 (1997)	E-CHAPTERSON T-LIGHTET BOSTO RESISTEN
1	:284	- 80			261				400	Staff, 26, Builder	D. Albert Stiller L. Aleset Dingle in Moord Pric.
1	ge.	101	51.5	200000000000000000000000000000000000000	1984				500	4949, 19, 509-69	p. 3,54m2 Select 1 - 2 sour FW (c) in Jersey Proc.
. 4	10.6		. 4	0.104811140	435				FOR	1547, (\$. 500-0)	Explaint the property of the property of the party of the
	185			5 - DEMITTON	6.70				3186	2007, 26, Rest Ch. 1	2 - Albert Stiffs + 3 - Albert FM (G) in Rewall PRE
4	Jak.		1.	2 - CRRET EVEC	439				104	286, 25 Sept On	2 - School Highler 2 - J. Scool Fat (Can Strend For
- 1	19.0			OF-400	900				(44)	3847, 29, 804 (24	2 COMPRISE 1 - J Great For play is broad that
	.180			264-407	1000				7500	Jaker, Ltt. Sold Co.	2 - Linear Matter + 3 - Linear TVI (Ellis Street PSC
+	-111	_		008 to 941	431				1600	100,16,600 da	4: Line of State 31: Lines (States Black Black Bit)
	-		FREE		11.00	100	0.00	9.00	LINGSON		
			m/m =		40.00						

SCHEDULE OF LOADS (SB HALL BUILDING)

SCALE NIS.

LIN VOITE	10 00	UPS	. 76	16		35.1			100 05 100
A 136					- 85		AV0418	MONTH.	
			10,00			22.7	1090.00	7545,25,4558	2 - 225 / 67 1805 - 1 - 6 Amer? Tot 300x 30mm2 Arc.
		LPYC	3504				1090.00	THE PERSON	J - 150 Art 1909 + 1 - 6, Suppl Yor 83 or 30 and 800.
4 100		(86)	36.06		-		1292-00	SAL SEATER	1. Throng 1800; + 1. A time? Yell \$5 in Financia \$6.
4 38		IPP	3504				Chican .	302,30303	1. Three! THIN 1. J. Allent! No. 62 or French Str.
-1-4	100		1800	4.00	100	1000	20100.00		

THE.	sports.	.06	19.7	OTHER LINE SERVER		empty.	MF	12	1000	CHO.41	80.0° N/8
,,-	494.00	12.	100	Decimal print interests	41.	CA.	80.	14	march.		
4.	286	- 4			3.44				346	36/3, 35, faire (b)	
2	- 200	.04			6.00				1969	2645, 25, Bell (81)	2. A fewer Chiefs of Labour the pile or January 1995.
1	385	- 34			6,67				300	JAME, IP, Bell-ID	2 - 4.2 min 1960y 41 - 6.2 min 196 bit is present byt.
4	208.1		. 4	X-CHRT NOT	.644.				. 708	26/3, 2F, 86(F-01)	2 - E3/30/1980 +1 - E3wy TV 30 is 39web FVs
5.	2.0kg 1.1		4	3-08A1564	544				799	3647, 3r, Bart, Gro.	1 - Kilowof 1980s vs Kilowof the Jill to Harring NVC
4	196		4	1 ONETHE	9.12				715	(641, 9, 601, 61	E-RENGTHER AT SOMETHING IS IN TRANSPORT
	-		7015		zhan	949	8.00	6.00	1700.00		

SCHEDULE OF LOADS (TOILET)

SCALE NTS.

er ken.			SWY, MCH	attell placement	A	州州兵	Mr.	141	SOLT AND THE	CBGUE MCMOR	AND ROWS	
	-	1.0	ED-		46	-19-	- 60				July de Label	
5	2.9	4	14	- 1000000000000000000000000000000000000	1,035	11.7	111	100	168	304C35,MC18	2 - Linear Water + 1 - 2 Story Par 100 + 20+ and Pric	
2	346			LINYSOCIE PICTOR	5.04				318	304:35,9618	2 - Silvery Time + 1 - Silvery Twister Shored His	
Α.	39			THE SALES HAVE	0.68				168	306, (1,001)	1 - 5,5 mm* WHIRE + 1 - 3,5 mm* FIRE \$1,000,000,000,000	
			7874	2	8.36	6.40	140	9.00	11.00			
		- 11	0/250 -		21.20	Anne						
П		- 11	orana -		21.30	Anger						

SCHEDULE OF LOADS (PRESSURE WATER TANK)

THE RESERVE OF STREET crime with -COMPLICATIONS. BEDIGN ARMO, PE, ARCER ARMO, PE, ARCER ARMO, PE, ARCER 1 - Electri 1900 - 1 - Electri 191 (Electri 1974) 2 - Electri 1900 - 1 - Electri 192 (Electri 1974) 3 - Electri 1900 - 1 - Electri 193 (Electrici) A DESCRIPTION 2.8FAC3 8.00 161 1967, (2,1618 2:33000880:1-330079 RECOVATOR Postdard hat: Use 1-base/tem+1-53w/ Wilsin Residence.

3	SCHEDULE C	OF LOADS (MATHAY	BUILDING)
---	------------	------------	--------	-----------

SCHEDULE OF LOADS (RP-US BUILDING)

SCALE NTS. ON TARKE

SCALE NYS.



Republika ng Pilipines Lungsod mg Quesco CITY ENGINEERING DEPARTMENT

PRODUCT TITLE PROPOSED UPGRADING OF **ELECTRICAL SYSTEM AT VILLA VERDE** ELEMENTARY SCHOOL / BRICK STA MONCA DISTRICT 6 , QUEZONOTY,

DEMINET : энский Ж

ENGR. LISO S. DEL ROSARIO

ENDR. ISAGARITA, VERZOSA, JR.


AND PROPERTY AND PROPERTY.

HON, BA. JOSEFINA G. BELMONTE

APPROVED BY

EL-04 SQUALITY OF LICENCE 06 07

DESCRIPTION TO SHE

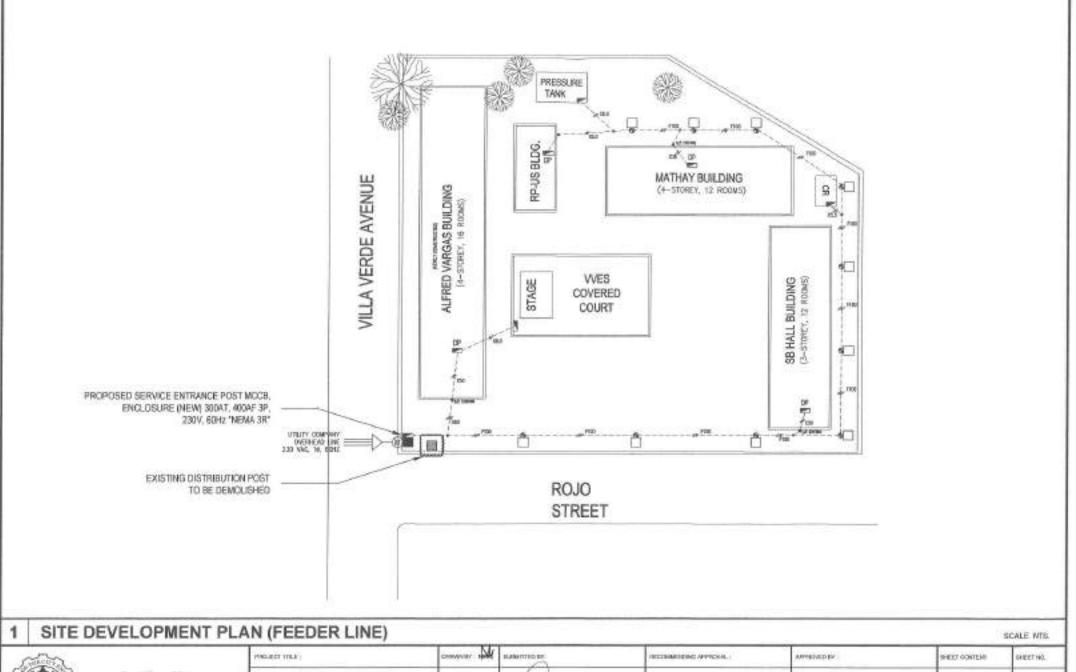

Republika ng Pilipinen
Lampsod ng Queron
CITY ENGINEERING DEPARTMENT

PARCHET TITLE
PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE ELEMENTARY SCHOOL
LOCATION BROY, STA MENNICA, DIREPRET E , DELETINICITY



/ / V	
ENGR. ISMSAN R. VERZOSA	Jir.

HON. MA. JOSEFINA G. BELNOWTE COV MARCO

SITE DEVELOPMENT OF MEL-06

Section VIII. Bill of Quantities

Notes on the Bill of Quantities

Objectives

The objectives of the Bill of Quantities are:

- a. to provide sufficient information on the quantities of Works to be performed to enable Bids to be prepared efficiently and accurately; and
- b. when a Contract has been entered into, to provide a priced Bill of Quantities for use in the periodic valuation of Works executed.

In order to attain these objectives, Works should be itemized in the Bill of Quantities in sufficient detail to distinguish between the different classes of Works, or between Works of the same nature carried out in different locations or in other circumstances which may give rise to different considerations of cost. Consistent with these requirements, the layout and content of the Bill of Quantities should be as simple and brief as possible.

Daywork Schedule

A Daywork Schedule should be included only if the probability of unforeseen work, outside the items included in the Bill of Quantities, is high. To facilitate checking by the Entity of the realism of rates quoted by the Bidders, the Daywork Schedule should normally comprise the following:

- a. A list of the various classes of labor, materials, and Constructional Plant for which basic daywork rates or prices are to be inserted by the Bidder, together with a statement of the conditions under which the Contractor will be paid for work executed on a daywork basis.
- b. Nominal quantities for each item of Daywork, to be priced by each Bidder at Daywork rates as Bid. The rate to be entered by the Bidder against each basic Daywork item should include the Contractor's profit, overheads, supervision, and other charges.

Provisional Sums

A general provision for physical contingencies (quantity overruns) may be made by including a provisional sum in the Summary Bill of Quantities. Similarly, a contingency allowance for possible price increases should be provided as a provisional sum in the Summary Bill of Quantities. The inclusion of such provisional sums often facilitates budgetary approval by avoiding the need to request periodic supplementary approvals as the future need arises. Where such provisional sums or contingency allowances are used, the SCC should state the manner in which they will be used, and under whose authority (usually the Procuring Entity's Representative's).

The estimated cost of specialized work to be carried out, or of special goods to be supplied, by other contractors should be indicated in the relevant part of the Bill of Quantities as a particular provisional sum with an appropriate brief description. A separate procurement procedure is normally carried out by the Procuring Entity to select such specialized contractors. To provide an element of competition among the Bidders in respect of any facilities, amenities, attendance, etc., to be provided by the successful Bidder as prime Contractor for the use and convenience of the specialist contractors, each related provisional sum should be followed by an item in the Bill of Quantities inviting the Bidder to quote a sum for such amenities, facilities, attendance, etc.

Signature Box

A signature box shall be added at the bottom of each page of the Bill of Quantities where the authorized representative of the Bidder shall affix his signature. Failure of the authorized representative to sign each and every page of the Bill of Quantities shall be a cause for rejection of his bid.

These Notes for Preparing a Bill of Quantities are intended only as information for the Procuring Entity or the person drafting the Bidding Documents. They should not be included in the final documents.

PROJECT TITLE :	PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE
	ELEMENTARY SCHOOL

LOCATION : BARANGAY STA. MONICA, DISTRICT 5, QUEZON CITY

PROJECT NO. : 22 - 00160

DURATION: Thirty (30) Calendar Days

BREAKDOWN OF COST

ITEM CODE	ITEM OF WORK (DESCRIPTION)	MATERIALS COST	LABOR COST	INDIRECT COST	AGGREGATE COST
GR	GENERAL REQUIREMENTS				
OGR	OTHER GENERAL REQUIREMENTS				
SW	SITE WORKS				
EW	ELECTRICAL WORKS				
UTI	UTILITY AND ANCILARY WORKS				

			_	
LUMP SUM BID IN WORDS	S:	 		
-				
Contractor :				

TOTAL COST P

Bid Form Page 3 of 3

BILL OF QUANTITIES

(Building Construction/Rehabilitation Project)

PROJECT TITLE: PROPOSED UPGRADING OF ELECTRICAL SYSTEM AT VILLA VERDE

ELEMENTARY SCHOOL

LOCATION : BARANGAY STA. MONICA, DISTRICT 5, QUEZON CITY

PROJECT NO. : 22 - 00160

DURATION: Thirty (30) Calendar Days

SCOPE OF WORK:

GR	General Requirements include billboard(s).
OGR	Other General Requirements (non-O.C.M) include, but not limited to:
1	Temporary enclosure around the construction area.
2	Temporary water system including water meter/sub-meter and connections.
3	Temporary electrical system including electric meter/sub-meter and connections.
4	Clearing, hauling and disposal of construction materials and debris.
5	Scaffolding for general use (rental).
SW	Site Works:
1	Demolition/removal works.
EW	Electrical Works:
1	Installation of roughing-ins and wirings.
2	Installation of system devices, panelboards, switchgears and accessories.
UTI	Utility and Ancillary Works:
1	Construction of electrical utilities include service entrance post and ground earth pit
0	Others (included in O.C.M.)
1	Provision of construction, health and safety such as safety gears, medical kit,etc.
2	Preparation of shop drawings, as necessary.
3	Preparation of as-built plans (signed and sealed by the respective professional(s)).
4	Testing and commissioning works shall be performed as per standard procedures.

ITEM CODE	WORK DESCRIPTION AND SCOPE OF WORKS	QTY.	UNIT	UNIT COST	TOTAL COST
GR	GENERAL REQUIREMENTS				
SPL7	Billboard (1.20m x 2.40m in Plywood)	1	piece	₱	₱
			MATE	RIAL COST GR	₽
			LA	BOR COST GR	
			DIR	ECT COST GR	₱
OGR	OTHER GENERAL REQUIREMENTS				
OGR02c	Temporary Enclosure at the Construction Area (Coveraged Length; H=2.4m)	7	l.m.	₱	₽
OGR0301	Temporary Water Facility	1	unit		
OGR0302	Temporary Electrical Facility	1	unit		
				Subtotal	₽

ITEM CODE	WORK DESCRIPTION AND SCOPE OF WORKS	QTY.	UNIT	UNIT COST	TOTAL COST
OGR01	Clearing, Hauling and Disposal of Construction Materials and Debris	1	t.l.		
OGR05	Scaffolding (Rental)	7	sq.m.		
				Subtotal	₱
			DIRECT COST OGR		₽

ITEM CODE	WORK DESCRIPTION AND SCOPE OF WORKS	QTY.	UNIT	UNIT COST	TOTAL COST
SW	SITE WORKS				
DEMV004	Removal of Existing Structure (Old Service Entrance Post)	4	cu.m.	₽	₽
			DID	FOT COOT OW	A
			DIR	ECT COST SW	P
EW	ELECTRICAL WORKS				
EW01	Roughing-ins				
EW0133	80mmØ RSC Pipe	4	piece	I ₱	₽
EW05	Fittings And Accessories	7	piece	1	1
EW05058	80mmØ IMC Coupling	2	piece		
EW05116	80mmØ IMC Locknut and Bushing		<u> </u>		
EW05160	Ü	2	pair		
EW05164	80mmØ Weatherproof Entrance Cap Secondary rack w/ 3 spool, Heavy duty "BETA"	2 11	piece set		
LVV03104	Secondary rack w/ 3 spool, rieavy duty BETA	11	Set		
EW09	Wires and Cables				
EW090103	5.5mm² THHN Wire	14	l.m.		
EW090104	8.0mm² THHN Wire	14	l.m.		
EW090107	30mm² THHN Wire	14	l.m.		
EW090108	38mm² THHN Wire	14	l.m.		
EW090109	50mm² THHN Wire	14	l.m.		
EW090115	175mm² THHN Wire	36	l.m.		
EW090212	100mm² THW Wire	450	l.m.		
EW090307a	30mm² TW Wire	1	roll		
EW12	Grounding System				
EW1202	20mm Ø x 3000mm Grounding Rod (Copper Clad) with Ground Clamp	1	piece		
EW1203	16mmØ x 250mm Oval Eye Bolt with Nut	5	piece		
EW16	Pipe Hangers and Supports				
EW1602	Vertical Layout of Pipe	40	l.m.		
EW14	Panelboard				
ASSY	MCB	1	assy		
	Main: 300AT, 400AF, 3P, 230V, MCCB				
	Enclosure: NEMA 3R				
MC	Miscellaneous and Consumables		1		
MC/G06	Hacksaw Blade	5	piece		
MC/G07	Masking Tape	5	roll		
MC/G37	GI Tie Wire, Ga. 16	1	kg		
MC/E01	Electrical Tape	30	roll		
MC/E03	Pulling Lubricant	1	can		
MC/E04	Rubber Tape	15	roll		
			MATER	ALS COST EW	₱
			LA	BOR COST EW	
			DIR	ECT COST EW	₱

ITEM CODE	WORK DESCRIPTION AND SCOPE OF WORKS	QTY.	UNIT	UNIT COST	TOTAL COST
UTI	UTILITY AND ANCILARY WORKS				
UT01	Electrical Utilities				
UT0101	Service Entrance				
UT010107	400mm x 400mm x 6000mm Electrical Service	1	unit	₱	₱
UT0103	Grounding Earth Pit				
UT010301	Earth Pit 0.30 x 0.30 x 0.15	1	unit		
			DIR	ECT COST UTI	₱

ITEM CODE	WORK DESCRIPTION AND SCOPE OF WORKS	QTY.	UNIT	UNIT COST	TOTAL COST
-----------	-------------------------------------	------	------	-----------	------------

SUMMARY

ITEM CODE	WORK	DESCRIPTION AND SCOPE OF WORKS	TOTAL COST
OGR	OTHER GENERAL REQU	IREMENTS	₽
		TOTAL ESTIMATED COST A	
GR SW EW UTI	GENERAL REQUIREMEN SITE WORKS ELECTRICAL WORKS UTILITY AND ANCILARY		₽
	ealth protocols relative to ble DPWH memorandum	TOTAL DIRECT COST B Overnead, Contingencies and Miscellaneous Expenses (OCM) PROFIT	
		TOTAL ESTIMATED COST B	₽
		TOTAL ESTIMATED COST A TOTAL ESTIMATED COST B TOTAL ESTIMATED COST	
		VAT	
		TOTAL APPROVED BUDGET FOR THE CONTRACT	₽

Section IX. Checklist of Technical and Financial Documents

Notes on the Checklist of Technical and Financial Documents

The prescribed documents in the checklist are mandatory to be submitted in the Bid, but shall be subject to the following:

- a. GPPB Resolution No. 09-2020 on the efficient procurement measures during a State of Calamity or other similar issuances that shall allow the use of alternate documents in lieu of the mandated requirements; or
- b. any subsequent GPPB issuances adjusting the documentary requirements after the effectivity of the adoption of the PBDs.

The BAC shall be checking the submitted documents of each Bidder against this checklist to ascertain if they are all present, using a non-discretionary "pass/fail" criterion pursuant to Section 30 of the 2016 revised IRR of RA No. 9184.

Checklist of Technical and Financial Documents

I. TECHNICAL COMPONENT ENVELOPE

Class "A" Documents

Leg	al Do	<u>cuments</u>
	(a)	Valid PhilGEPS Registration Certificate (Platinum Membership) (all pages);
	(b)	and Registration certificate from Securities and Exchange Commission (SEC), Department of Trade and Industry (DTI) for sole proprietorship, or Cooperative Development Authority (CDA) for cooperatives or its equivalent document;
	(c)	and Mayor's or Business permit issued by the city or municipality where the principal place of business of the prospective bidder is located, or the equivalent document for Exclusive Economic Zones or Areas; and
	(e)	Tax clearance per E.O. No. 398, s. 2005, as finally reviewed and approved by the Bureau of Internal Revenue (BIR).
Tec	hnica	l Documents
	(f)	Statement of the prospective bidder of all its ongoing government and private contracts, including contracts awarded but not yet started, if any, whether similar or not similar in nature and complexity to the contract to be bid (please see attached prescribed forms required by the QC – BAC for Infrastructure and Consultancy); and
	(g)	Statement of the bidder's Single Largest Completed Contract (SLCC) similar to the contract to be bid, except under conditions provided under the rules with an attached Notice of Award, Notice to Proceed, Contract and Certificate of Acceptance (please see attached prescribed form required by the QC – BAC for Infrastructure and Consultancy); and
	(h)	Philippine Contractors Accreditation Board (PCAB) License; or Special DCAB License in case of Joint Ventures:
	(i)	Special PCAB License in case of Joint Ventures; and registration for the type and cost of the contract to be bid; and Original copy of Bid Security. If in the form of a Surety Bond, submit also a certification issued by the Insurance Commission;
	(j)	or Original copy of Notarized Bid Securing Declaration; and Project Requirements, which shall include the following: a. Organizational chart for the contract to be bid;
		b. List of contractor's key personnel (e.g., Project Manager, Project Engineers, Materials Engineers, and Foremen), to be assigned to the contract to be bid, with their complete qualification and experience data (please see attached prescribed form required by the QC – BAC for Infrastructure and Consultancy);
		c. List of contractor's major equipment units, which are owned, leased, and/or under purchase agreements, supported by proof of ownership or certification of availability of equipment from the equipment

see attached prescribed form required by the QC - BAC for Infrastructure and Consultancy); and Original duly signed Omnibus Sworn Statement (OSS); \sqcap (k) and if applicable, Original Notarized Secretary's Certificate in case of a corporation, partnership, or cooperative; or Original Special Power of Attorney of all members of the joint venture giving full power and authority to its officer to sign the OSS and do acts to represent the Bidder. Additional Technical Requirements: Certificate of Site Inspection or Affidavit of Site Inspection as part of Omnibus Sworn Statement • Affidavit of Undertaking for Key Personnel and Equipment (please see attached prescribed form required by the QC – BAC for Infrastructure and Consultancy) ■ • Equipment Utilization Schedule Manpower Schedule Construction Schedule and S-Curve □ • PERT-CMP ☐ • Construction Methods Financial Documents (1) The prospective bidder's audited financial statements, showing, among others, the prospective bidder's total and current assets and liabilities, stamped "received" by the BIR or its duly accredited and authorized institutions, for the preceding calendar year which should not be earlier than two (2) years from the date of bid submission; and The prospective bidder's computation of Net Financial Contracting Capacity П (m) (NFCC) (please see attached prescribed form required by the QC – BAC for *Infrastructure and Consultancy*). Class "B" Documents If applicable, duly signed joint venture agreement (JVA) in accordance with \square (n) RA No. 4566 and its IRR in case the joint venture is already in existence; or duly notarized statements from all the potential joint venture partners stating that they will enter into and abide by the provisions of the JVA in the instance that the bid is successful. II. FINANCIAL COMPONENT ENVELOPE (o) Original of duly signed and accomplished Financial Bid Form; and Other documentary requirements under RA No. 9184 Original of duly signed Bid Prices in the Bill of Quantities; and П (p) (q) Duly accomplished Detailed Estimates Form, including a summary shee

lessor/vendor for the duration of the project, as the case may be (please

rentals used in coming up with the Bid; and

Cash Flow by Quarter.

indicating the unit prices of construction materials, labor rates, and equipmen

(r)

Bid Form for the Procurement of Infrastructure Projects

[shall be submitted with the Bid]

BID FORM	
Date : Project Identification No. :	

To: [name and address of Procuring Entity]

Having examined the Philippine Bidding Documents (PBDs) including the Supplemental or Bid Bulletin Numbers [insert numbers], the receipt of which is hereby duly acknowledged, we, the undersigned, declare that:

- We have no reservation to the PBDs, including the Supplemental or Bid Bulletins, for the Procurement Project: [insert name of contract];
- b. We offer to execute the Works for this Contract in accordance with the PBDs:
- The total price of our Bid in words and figures, excluding any discounts offered below is: [insert information];
- d. The discounts offered and the methodology for their application are: [insert information];
- e. The total bid price includes the cost of all taxes, such as, but not limited to: [specify the applicable taxes, e.g. (i) value added tax (VAT), (ii) income tax, (iii) local taxes, and (iv) other fiscal levies and duties], which are itemized herein and reflected in the detailed estimates,
- f. Our Bid shall be valid within the a period stated in the PBDs, and it shall remain binding upon us at any time before the expiration of that period;
- g. If our Bid is accepted, we commit to obtain a Performance Security in the amount of [insert percentage amount] percent of the Contract Price for the due performance of the Contract, or a Performance Securing Declaration in lieu of the the allowable forms of Performance Security, subject to the terms and conditions of issued GPPB guidelines¹ for this purpose;
- We are not participating, as Bidders, in more than one Bid in this bidding process, other than alternative offers in accordance with the Bidding Documents;
- We understand that this Bid, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal Contract is prepared and executed; and
- We understand that you are not bound to accept the Lowest Calculated Bid or any other Bid that you may receive.

currently based on GPPB Resolution No. 09-2020

- k. We likewise certify/confirm that the undersigned, is the duly authorized representative of the bidder, and granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for the [Name of Project] of the [Name of the Procuring Entity].
- We acknowledge that failure to sign each and every page of this Bid Form, including the Bill of Quantities, shall be a ground for the rejection of our bid.

Name:	
Legal Capacity:	
Signature:	
Duly authorized to sign the Bid for and behalf of:	
Date:	

Bid Securing Declaration Form

[shall be submitted with the Bid if bidder opts to provide this form of bid security]

REPUBLIC OF THE PHILIPPINES)	
CITY OF) S.S.

BID SECURING DECLARATION Project Identification No.: [Insert number]

To: [Insert name and address of the Procuring Entity]

I/We, the undersigned, declare that:

- I/We understand that, according to your conditions, bids must be supported by a Bid Security, which may be in the form of a Bid Securing Declaration.
- 2. I/We accept that: (a) I/we will be automatically disqualified from bidding for any procurement contract with any procuring entity for a period of two (2) years upon receipt of your Blacklisting Order; and, (b) I/we will pay the applicable fine provided under Section 6 of the Guidelines on the Use of Bid Securing Declaration, within fifteen (15) days from receipt of the written demand by the procuring entity for the commission of acts resulting to the enforcement of the bid securing declaration under Sections 23.1(b), 34.2, 40.1 and 69.1, except 69.1(f), of the IRR of RA No. 9184; without prejudice to other legal action the government may undertake.
- I/We understand that this Bid Securing Declaration shall cease to be valid on the following circumstances:
 - Upon expiration of the bid validity period, or any extension thereof pursuant to your request;
 - I am/we are declared ineligible or post-disqualified upon receipt of your notice to such effect, and (i) I/we failed to timely file a request for reconsideration or (ii) I/we filed a waiver to avail of said right; and
 - I am/we are declared the bidder with the Lowest Calculated Responsive Bid, and I/we have furnished the performance security and signed the Contract,

IN WITNESS WHEREOF, I/We have hereunto set my/our hand/s this ____ day of [month] [year] at [place of execution].

[Insert NAME OF BIDDER OR ITS AUTHORIZED REPRESENTATIVE] [Insert signatory's legal capacity] Affiant

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Omnibus Sworn Statement (Revised)

[shall be submitted with the Bid]

REPUBLIC OF THE PHILIPPINES)				
CITY/MUNICIPALITY OF) S.S.			

AFFIDAVIT

I, [Name of Affiant], of legal age, [Civil Status], [Nationality], and residing at [Address of Affiant], after having been duly sworn in accordance with law, do hereby depose and state that:

1. [Select one, delete the other:]

[If a sole proprietorship:] I am the sole proprietor or authorized representative of [Name of Bidder] with office address at [address of Bidder];

[If a partnership, corporation, cooperative, or joint venture:] I am the duly authorized and designated representative of [Name of Bidder] with office address at [address of Bidder];

2. [Select one, delete the other:]

[If a sole proprietorship:] As the owner and sole proprietor, or authorized representative of [Name of Bidder], I have full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached duly notarized Special Power of Attorney;

[If a partnership, corporation, cooperative, or joint venture:] I am granted full power and authority to do, execute and perform any and all acts necessary to participate, submit the bid, and to sign and execute the ensuing contract for [Name of the Project] of the [Name of the Procuring Entity], as shown in the attached [state title of attached document showing proof of authorization (e.g., duly notarized Secretary's Certificate, Board/Partnership Resolution, or Special Power of Attorney, whichever is applicable;)];

- 3. [Name of Bidder] is not "blacklisted" or barred from bidding by the Government of the Philippines or any of its agencies, offices, corporations, or Local Government Units, foreign government/foreign or international financing institution whose blacklisting rules have been recognized by the Government Procurement Policy Board, by itself or by relation, membership, association, affiliation, or controlling interest with another blacklisted person or entity as defined and provided for in the Uniform Guidelines on Blacklisting;
- 4. Each of the documents submitted in satisfaction of the bidding requirements is an authentic copy of the original, complete, and all statements and information provided therein are true and correct;
- 5. [Name of Bidder] is authorizing the Head of the Procuring Entity or its duly authorized representative(s) to verify all the documents submitted;

6. [Select one, delete the rest:]

[If a sole proprietorship:] The owner or sole proprietor is not related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a partnership or cooperative:] None of the officers and members of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project

Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

[If a corporation or joint venture:] None of the officers, directors, and controlling stockholders of [Name of Bidder] is related to the Head of the Procuring Entity, members of the Bids and Awards Committee (BAC), the Technical Working Group, and the BAC Secretariat, the head of the Project Management Office or the end-user unit, and the project consultants by consanguinity or affinity up to the third civil degree;

- 7. [Name of Bidder] complies with existing labor laws and standards; and
- 8. [Name of Bidder] is aware of and has undertaken the responsibilities as a Bidder in compliance with the Philippine Bidding Documents, which includes:
 - a. Carefully examining all of the Bidding Documents;
 - b. Acknowledging all conditions, local or otherwise, affecting the implementation of the Contract;
 - Making an estimate of the facilities available and needed for the contract to be bid, if any; and
 - d. Inquiring or securing Supplemental/Bid Bulletin(s) issued for the [Name of the Project].
- 9. [Name of Bidder] did not give or pay directly or indirectly, any commission, amount, fee, or any form of consideration, pecuniary or otherwise, to any person or official, personnel or representative of the government in relation to any procurement project or activity.
- 10. In case advance payment was made or given, failure to perform or deliver any of the obligations and undertakings in the contract shall be sufficient grounds to constitute criminal liability for Swindling (Estafa) or the commission of fraud with unfaithfulness or abuse of confidence through misappropriating or converting any payment received by a person or entity under an obligation involving the duty to deliver certain goods or services, to the prejudice of the public and the government of the Philippines pursuant to Article 315 of Act No. 3815 s. 1930, as amended, or the Revised Penal Code.
- 11. We pledge that the project will be completed in accordance and congruency with the approved plans and programs.

IN WITNESS WHEREOF, I have hereunto set my hand this _	day of	20	_ at
, Philippines.			

[Insert NAME OF BIDDER OR ITS AUTHORIZED REPRESENTATIVE]
[Insert signatory's legal capacity]
Affiant

[Jurat]

[Format shall be based on the latest Rules on Notarial Practice]

Contract Agreement Form for the Procurement of Infrastructure Projects (Revised)

[not required to be submitted with the Bid, but it shall be submitted within ten (10) days after receiving the Notice of Award]

CONTRACT AGREEMENT

THIS AGREEMENT, made this [insert date] day of [insert month], [insert year] between [name and address of PROCURING ENTITY] (hereinafter called the "Entity") and [name and address of Contractor] (hereinafter called the "Contractor").

WHEREAS, the Entity is desirous that the Contractor execute [name and identification number of contract] (hereinafter called "the Works") and the Entity has accepted the Bid for [contract price in words and figures in specified currency] by the Contractor for the execution and completion of such Works and the remedying of any defects therein.

NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

- In this Agreement, words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract hereinafter referred to.
- The following documents as required by the 2016 revised Implementing Rules and Regulations of Republic Act No. 9184 shall be deemed to form and be read and construed as part of this Agreement, viz.:
 - a. Philippine Bidding Documents (PBDs);
 - Drawings/Plans:
 - ii. Specifications;
 - iii. Bill of Quantities:
 - iv. General and Special Conditions of Contract;
 - v. Supplemental or Bid Bulletins, if any;
 - Winning bidder's bid, including the Eligibility requirements, Technical and Financial Proposals, and all other documents or statements submitted;

Bid form, including all the documents/statements contained in the Bidder's bidding envelopes, as annexes, and all other documents submitted (e.g., Bidder's response to request for clarifications on the bid), including corrections to the bid, if any, resulting from the Procuring Entity's bid evaluation;

- c. Performance Security;
- d. Notice of Award of Contract and the Bidder's conforme thereto; and
- e. Other contract documents that may be required by existing laws and/or the Procuring Entity concerned in the PBDs. <u>Winning bidder agrees that</u> additional contract documents or information prescribed by the GPPB that are subsequently required for submission after the contract execution, such as the Notice to Proceed, Variation Orders, and Warranty Security, shall likewise form part of the Contract.
- In consideration for the sum of [total contract price in words and figures] or such other sums as may be ascertained, [Named of the bidder] agrees to [state the object of the contract] in accordance with his/her/its Bid.

4. The [Name of the procuring entity] agrees to pay the above-mentioned sum in accordance with the terms of the Bidding.

IN WITNESS whereof the parties thereto have caused this Agreement to be executed the day and year first before written.

[Insert Name and Signature] [Insert Name and Signature]

[Insert Signatory's Legal Capacity] [Insert Signatory's Legal Capacity]

for:

for:

[Insert Procuring Entity] [Insert Name of Supplier]

Acknowledgment

[Format shall be based on the latest Rules on Notarial Practice]

NAME OF CONTRACTOR:	

PROJECT TIFLE		9220-22292	100000000000000000000000000000000000000		CONTRACTOR'S ROLE (SOLE CONTRACTOR, SUBCONTRACTOR,	TOTAL	DATE OF	TOTAL	PERCE	NTAGE	
(Name of the Contract) B. EXACT PROJECT LOCATION	DATE OF CONTRACT	DURATION	PROJECT OWNER & POSTAL ADDRESS	NATURE OF WORK	INTEREST IN A 3/) and PERCENTAGE OF PARTICIPATION	CONTRACT VALUE AT AWARD	COMPLETION of ESTIMATED COMPLETION TIME	VALUE AT COMPLETION IF APPLICABLE	ACTUAL ACCOMPUSHMENT	PLANNED ACCOMPUSHMENT	VALUE OF OUTSTANDIN WORKS (IN PHP)
									TOTAL AMOUNT OUTSTANDING V		

PHOTOCOPY ADDITIONAL FORMS, IF NECESSARY

Page of

NAME OF CONTRACTOR: PROJECT TITLE: _____ ROLE OF BIDDER IN THE MAJOR SCOPE OF WORKS & DATE CONTRACT PRICE CONTRACT SOLE NAME AND ADDRESS DATE OF SCHEDULED PROJECT TITLE & EXACT LOCATION STARTED OF PROJECT OWNER (PHP) AS AWARDED CONTRACTOR / SUB-COMPLETION CONTRACTOR/PARTNER IN A TOTAL AMOUNT

OF CONTRACT (Php)

LIST OF ALL AWARDED BUT NOT YET STARTED GOVERNMENT AND PRIVATE CONTRACTS OF THE BIDDER

PHOTOCOPY ADDITIONAL FORMS, IF NECESSARY

Page___of___

NAME OF CONTRACTOR: PROJECT TITLE:

PROJECT TITLE (Name of the Contract) & EXACT PROJECT LOCATION	DATE OF CONTRACT	CONTRACT	PROJECT OWNER & POSTAL ADDRESS	NATURE OF WORK	CONTRACTOR'S ROLE SOLE CONTRACTOR, SURCONTRACTOR, PARTHNER IN A JVI and PERCENTAGE OF PARTICIPATION	TOTAL CONTRACT VALUE AT AWARD	DATE OF COMPLETION OF ESTIMATED COMPLETION TIME	TOTAL CONTRACT VALUE AT COMPLETION IF APPLICABLE

	- 6	
Page	454	
F 94.80/w		

LIST OF MAJOR EQUIPMENT TO BE USED FOR THE PROJECT

NAME OF CONTRACTOR:	0-2		
DDO ISCT TITLE			
PROJECT TITLE:			

ТҮРЕ	DESCRIPTION / CAPACITY	SERIAL NO.	YEAR ACQUIRED	PRESENT LOCATION (SPECIFIC ADDRESS)	STATUS OF AVAILABILITY (OWNED/LEASED)

Page		
1 one	OI.	

A. LIST OF KEY CONSTRUCTION PERSONNEL TO BE ASSIGNED TO THE PROJECT

NAME OF CONTRACTOR:			
PROJECT TITLE:			

NAME	POSITION	AGE	EDUCATIONAL ATTAINMENT	TYPE OF CONSTRUCTION EXPERIENCE	NO.OF YEARS WITH THE CONTRACTOR	PROFESSION	PRC NO.

Page	of	
F HELD	174	

COMPUTATION OF NET FINANCIAL CONTRACTING CAPACITY (NFCC)

NAME OF BIDDER:				
	CURRENT ASSETS*		PHP	
	(LESS) CURRENT LIABILITIES*	(LESS)	РНР	
	NETWORTH		PHP	
	NETWORTH x 15	x 15	PHP	
	(LESS) VALUE OF ALL OUTSTANDING ON-GOING CONTRACTS**	(LESS)	PHP	
	(LESS) VALUE OF ALL AWARDED BUT NOT YET STARTED CONTRACTS AS OF DATE**	(LESS)	PHP	
	NET FINANCIAL CONTRACTING CAPACITY		РНР	
			-	

NOTES:

- CURRENT ASSETS AND LIABILITIES BASED ON AUDITED FINANCIAL STATEMENT FOR THE PRECEDING CALENDAR YEAR SUBMITTED TO B.I.R.
- ** BASED ON LIST OF ON-GOING AND AWRDED BUT NOT YEY STARTED CONTRACTS SUBMITTED

)	S. S.					
			AFFI	DAVIT OF	UNDI	ERTA	KING		
2012/2013	1,			of	legal	age,	Filipino,	[OFFICER	OF
REPR	ESENTA	TIVE)					1000 F2 10 10 F2	1200	
with c	office add	ress at							after
having	been du	ly sworn	to in accord	ance with law,	hereby	volum	atary depose ar	nd state:	
	That I a	am duly aking as	authorized i evidenced by	epresentative Secretary's C	of the ertifica	[Nam te and	e of Bidder Board Resolut	to execut	e this
	That _	[Name	of Bidder	_bidding for	he (Na	me of I	Project)		
	that the	equipm	ent to be use	tioned Project and the key pe project until it	ersonne	l to be	assign shall ex	_hereby undertal clusively be used	ke and
	That I a	m execut	ing this affic	lavit to attest technical require	o the tri	uth of t	the foregoing a public bidding	and in compliance g of the said proje	ect.
of	IN WE	INESS 1	HEREOF, I	have hereum	o sign	ed my	y name belov	w this	day
	AFFIAN	T FURT	HER SAYET	H NAUGHT.					
					-		Affiant		
	SUBSC	RIBED A	ND SWOR	N TO BEFORE	ME th	is	day of		77
		in					-		
affiant	exhibit	ing to	me his/h on	er				issued	at
Doc. No									
Page N	10.1								
Book N	70.00								
eries o	f 2020								

Notary Public

